

State of New Jersey
Department of Environmental Protection

2024 NEW JERSEY STATEWIDE WATER SUPPLY PLAN

APPENDIX K FUTURE POTABLE WATER AVAILABILITY FOR NEW JERSEY'S PUBLIC COMMUNITY WATER SYSTEMS



Appendix K:

Future Potable Water Availability for New Jersey’s Public Community Water Systems

TABLE OF CONTENTS

APPENDIX K	1
INTRODUCTION.....	3
PROCESS.....	3
ASSUMPTIONS	4
METHODOLOGY	4
STEP 1	4
STEP 2	5
STEP 3	7
STEP 4	7
STEP 5	7
STEP 6	8
FINDINGS AND SUMMARY	8

INTRODUCTION

The goal of the analysis is to model 2050 remaining water availability for public community water systems using current demands and surplus deficits and the result of the 2050 forecasted water demands (discussed in Appendix D and Chapter 4). Results of the analysis show areas of the State with surplus or deficit supplies in relation to currently approved supply, not natural resource capacity. This assessment, when combined with the natural resource limitations discussed in Chapters 2 and 4, provides a planning overview for determining areas of surplus and deficit in relation to approved supplies.

There are multiple data sources used to develop the analysis discussed here. Changes to any one of those datasets will change the results shown here. The analysis presented here is a snapshot based on current data where water availability concerns may exist in 2050.

PROCESS

This analysis subtracts the future water demand from a public water system's remaining available water as determined through the Bureau of Water System Engineering's Surplus/Deficit analysis. Four different future water use scenarios were utilized from a 2018 Rutgers report which was updated for the 2024 Plan with data through 2050. The remaining amount indicates whether a particular water system will have a surplus (remaining available approved supply) or a deficit (shortage of approved supply) for their identified water service area for the projected time period. Table K1 lists the data used in this analysis.

Table K.1 Datasets used in the analysis.

Data Title	Provider	Description	Data Location
Public Water System surplus/deficit	DEP/Bureau of Water System Engineering	Current water allocation surplus/deficit data for each water purveyor	DEP DWSG Public Water System Deficit/Surplus website
2050 Forecast Water Demands for New Jersey Public Community Water Supply Systems	Rutgers – The State University of New Jersey School of Environmental and Biological Sciences	Projected water demand based upon population projections for each municipality to 2050	Data available in NJSWSP 2024 Appendix D
New Jersey Municipal Boundaries	DEP/GIS	2009 New Jersey Municipal Boundaries	DEP Bureau of GIS New Jersey Municipal Boundaries
PWS Service Area Boundaries	DEP/GIS	1998 mapping available, internal deliberative revised dataset used in this analysis	DEP Bureau of GIS PWS Service Areas

ASSUMPTIONS

1. The analysis uses the Public Water System Deficit/Surplus data that was current as of (06/2021). This information is periodically updated and any changes to that dataset could result in changes to these results. Refer to the [DEP Firm Capacity and Water Allocation Analysis pdf](#) for details on this method.
2. Many small water systems do not have a surplus/deficit calculated for them and others do not have a mapped service area available. For those systems, a current surplus of zero was assumed.
3. Municipalities without a purveyor population served were assumed to not have a water system now or in the future.
4. The analysis assumes no changes to water supply infrastructure or additional permitted allocations (new or expanded sources of supply) in order to estimate the most conservative scenario for public water systems.
5. All projected population growth is assumed to be served by a public water system in future growth calculations.
6. Commercial demands are assumed to mirror the rate of Residential demands, and Industrial demands were held constant. These assumptions are not entirely correct but likely close enough for the modeling process.
7. Water loss is typically referred to as either non-revenue water or unaccounted for water. Although there are different ways of calculating water loss, it can generally be thought of as the volume of produced water that does not reach a purveyor customer base. In this analysis the rate of water loss is projected to 2050 in two different scenarios, both based on the findings of the Rutgers report, which examined the most recent reported water loss data available at the time. The nominal water loss scenario holds water loss at the median level of reported non-revenue water while the optimal water loss scenario assumes that all systems achieve water loss rates equivalent to the 25th percentile levels seen in the data (better systems), an aggressive assumption. It is important to note that due to the many variables that exist it is nearly impossible to project water loss rates over decades of time. Consequently, these should be considered general estimates that include substantial uncertainty.
8. The total modeled water demands incorporate Residential, Industrial and Commercial (RIC) demands plus water losses.

METHODOLOGY

The analysis required multiple steps, described below. Some datasets required manipulation so that they could be used in this analysis. The required inputs were: population growth for each municipality, and current surplus/deficit for each water purveyor. Figure K1 is a schematic of the analysis process.

STEP 1

The first step of the analysis to collect the surplus/deficit data and convert them into mgd for each water purveyor. The first input for this analysis was the current (2021) surplus or deficit for each purveyor. Public water system surplus/deficit results are determined from an analysis done by the Division of Water Supply and Geoscience's Bureau of Water System Engineering. 583 public community water systems are included in their current surplus/deficit analysis of which 82 do not have any surplus/deficit information available because of their small size and falling under reporting limits.

The surplus/deficit analysis and resulting summary table contains three values which were utilized in this analysis: Water Allocation Monthly Average Daily Demand (MADD), and Water Allocation Annual Average Daily Demand (AADD). The MADD and AADD values are based on existing water allocation permit limits and bulk purchase contracts. More information of this process can be found in the following document: [DEP Firm Capacity and Water Allocation Analysis pdf](#).

The current surplus/deficit for each water purveyor was determined by finding the most limiting value from the MADD or AADD which was converted to mgd. The conversion process is shown in the Table K2. All remaining systems without a surplus/deficit determination were assumed to have a surplus of 0 mgd in the model. After this process was completed, every system had a “surplus/deficit” value in mgd. These values are the Current Baseline for the analysis.

Table K.2 Unit Conversions.

Surplus/Deficit	Original Units	Conversion
MADD	mgm	Divide by 31
AADD	mgd	Divide by 365

Shorelands Water Company (#1339001) is included below in Table K3 to further clarify the conversion process.

Table K.3 Example of conversion process for a purveyor.

WSID#	Surplus/Deficit mgm	Surplus/Deficit mgd	mgm to mgd	mgd to mgd	Current Surplus/Deficit mgd
1339001	227.4	1802.5	7.3	4.9	0.3

STEP 2

The next step in the analysis is to gather average observed demand data for each water purveyor. Average observed data were generated using New Jersey Water-Transfer Data System (NJWaTr) database for each purveyor. NJWaTr is a database system that compiles, stores, and distributes New Jersey’s water use data for research and modeling purposes. For this analysis, observed data from the 2016-2020 period were used to generate an Average Observed Demand value in mgd for each purveyor.

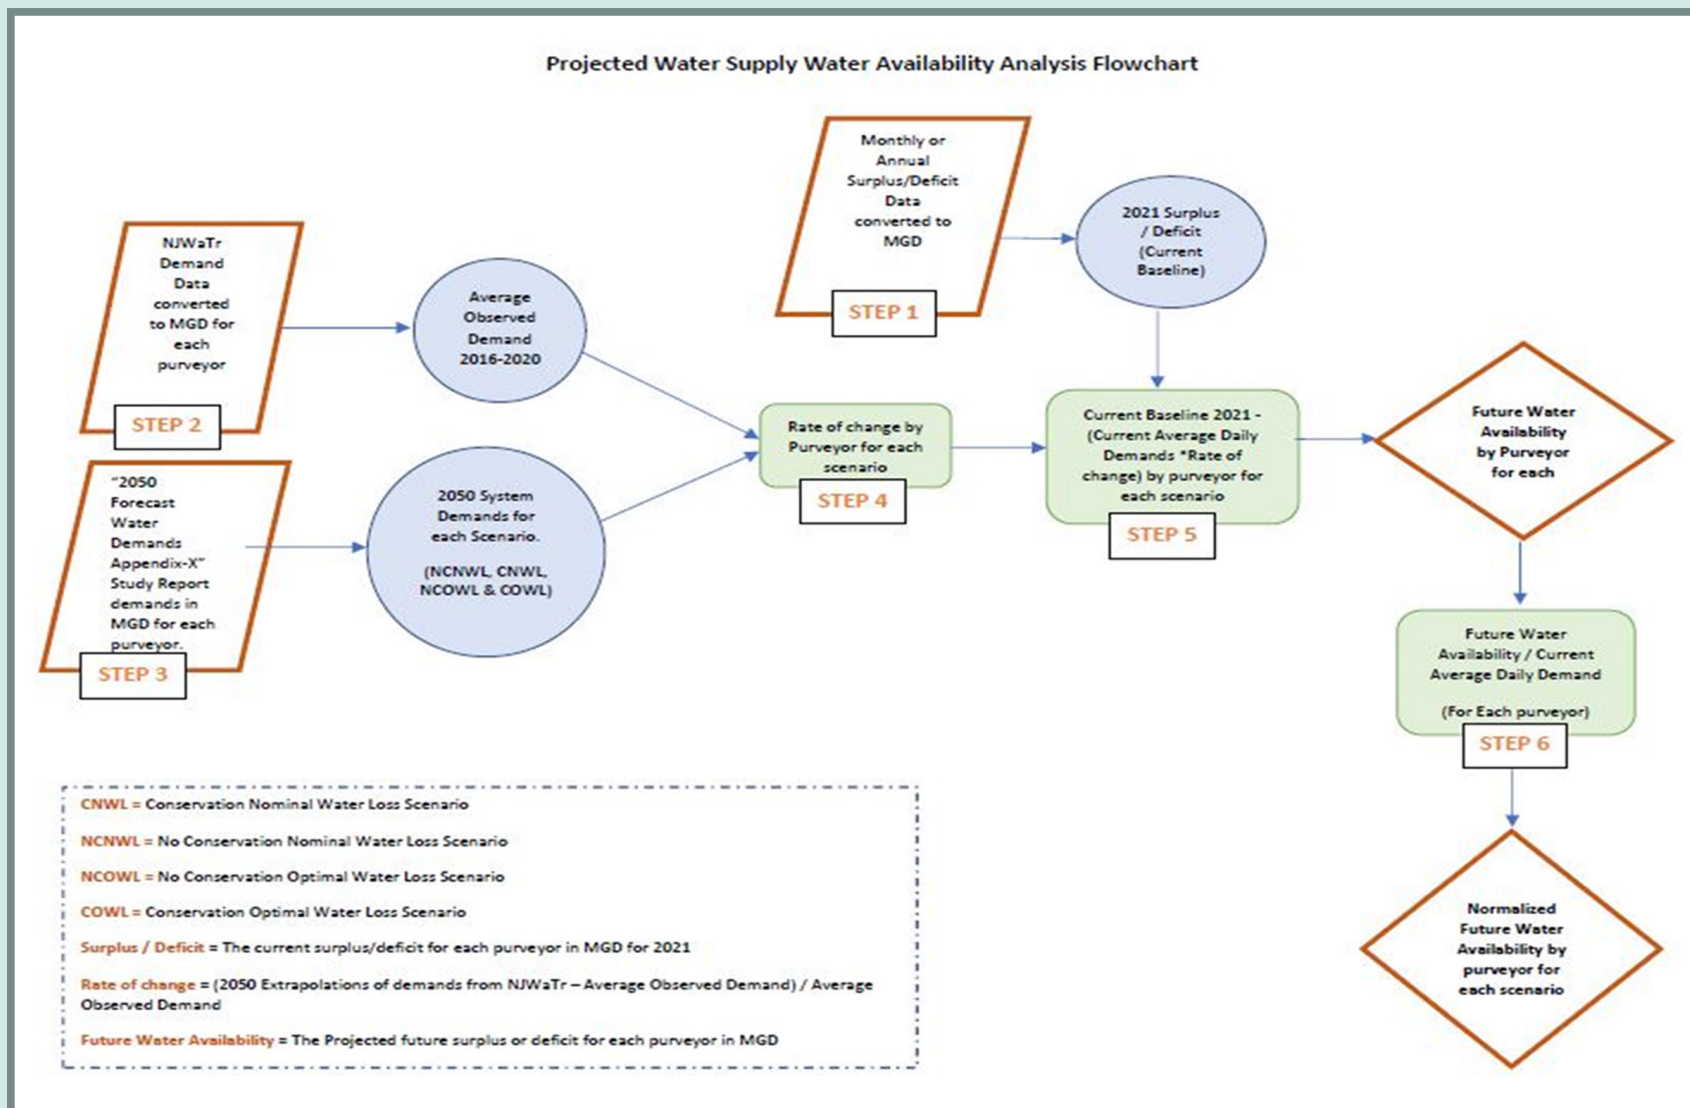


Figure K.1 Projected Water Supply Water Availability Analysis Flowchart

STEP 3

In this step of the analysis, 2050 forecasted demand data were compiled from the Rutgers Report. Four scenarios were selected from the report and the 2050 demand data was gathered for each scenario for each purveyor. The four scenarios incorporated different combinations of two options for the rate of water loss (typically referred to as either non-revenue water or unaccounted for water) and two options for the rate of conservation, all of which are detailed below.

1. **Nominal Water Loss:** water loss held at the current median levels based on current analysis of all systems in New Jersey that reported at the time of the NJSWSP
2. **Optimal Water Loss:** water loss rates for all systems equivalent to the current 25th percentile for all systems in New Jersey that reported at the time of the NJSWSP
3. **No Conservation scenario:** residential per capita and commercial demand rates not impacted by conservation practices
4. **Conservation scenario:** residential rates do decline gradually (10% reduction by 2050)

Based on the possible combinations of different options described above, the four scenarios that were selected for this analysis are provided below.

1. **CNWL** = Conservation Nominal Water Loss Scenario
2. **NCNWL** = No Conservation Nominal Water Loss Scenario
3. **NCOWL** = No Conservation Optimal Water Loss Scenario
4. **COWL** = Conservation Optimal Water Loss Scenario

After choosing the above mentioned four scenarios, 2050 system demands were collected for each purveyor for each scenario.

STEP 4

The next phase of the analysis determined the projected growth factor for each system in each scenario. The growth factor is the percent difference between the initial baseline and final estimation.

$$\text{Growth Factor} = \frac{(\text{2050 system demand} - \text{Average Observed Demand})}{\text{Average Observed Demand}}$$

STEP 5

The last part of the analysis determined the net future availability for each purveyor for 2050. The growth factor was multiplied by the current average daily demand resulting in an estimate of 2050 demand that was then subtracted from the current surplus/deficit value. This produced a value representing the predicted amount of surplus/deficit per system (future water available) for each purveyor for each scenario. The final surplus/deficit for each system was then mapped by linking the data to the drinking water service area boundaries using the Public Water System Identification Database (PWSID). The same example of Shorelands Water Company (#1339001) is included below in Table K4 to illustrate each step of the analysis.

Table K.4 Example of future 2050 future water availability calculation.

PWSID#	Growth Factor	Current Baseline Surplus/Deficit (mgd)	Average Daily Demand (mgd)
1339001	-0.090102	0.301205	4.9382

Future Water Availability 2050 for Shorelands Water Company (PWSID1339001) is calculated as follow:

$$0.301205 - (4.9382 \times -0.090102) = 0.7461 \text{ mgd}$$

STEP 6

The future water availability by water purveyor is an important piece of information for any one purveyor. However, the relative water availability between different purveyors can be misleading. For example, a water system with a large population served and surplus of only 1 mgd needs to be considered differently than a very small system with the same 1 mgd of availability. In other words, 1 mgd for a small system may be more than adequate to meet any future growth, but for a large system it would not be adequate.

To address this shortcoming, the future water availability for a system was divided by its current average daily demand. This resulted in a normalized future water availability that is a better metric for comparing one system to another.

Table K.5 Example of future 2050 Normalized future water availability calculation.

PWSID#	Growth Factor	Current Baseline Surplus/Deficit (mgd)	Future Water Availability (mgd)
1339001	0.086116	0.301205	0.7461

Normalized Future Water Availability 2050 for Shorelands Water Company (#1339001) is calculated as follow:

$$0.7461 / 0.301205 = 2.477$$

FINDINGS AND SUMMARY

Figures K2, K3, K4 and K5 show water purveyor with their corresponding deficit/surplus (left side) and the normalized future water availability (right side) for the 2050 projection periods. The normalized graphics enable comparison between systems by converting the deficit/surpluses into percentages relative to a system's current demand. Thus, comparison becomes possible despite differences of magnitude between larger vs smaller systems. Table K6 shows water purveyors with their corresponding deficit/surplus and the normalized future water availability for the 2050 projection periods.

This analysis identifies water purveyor future water availability based upon projected population growth. It identified both systems with and without adequate approved supply to satisfy projected population growth. While the uses of such an assessment need to be evaluated with the understanding that permit modifications or demand changes can alter the results, it is a useful statewide analysis to aid in identifying areas where there is currently available approved supply and those areas that are currently or are projected to require additional sources of supply. However, as indicated at the beginning of this appendix, it is important to consider the natural capacities of those areas, since areas with excess supply may have limitations to the sustainability of the excess.

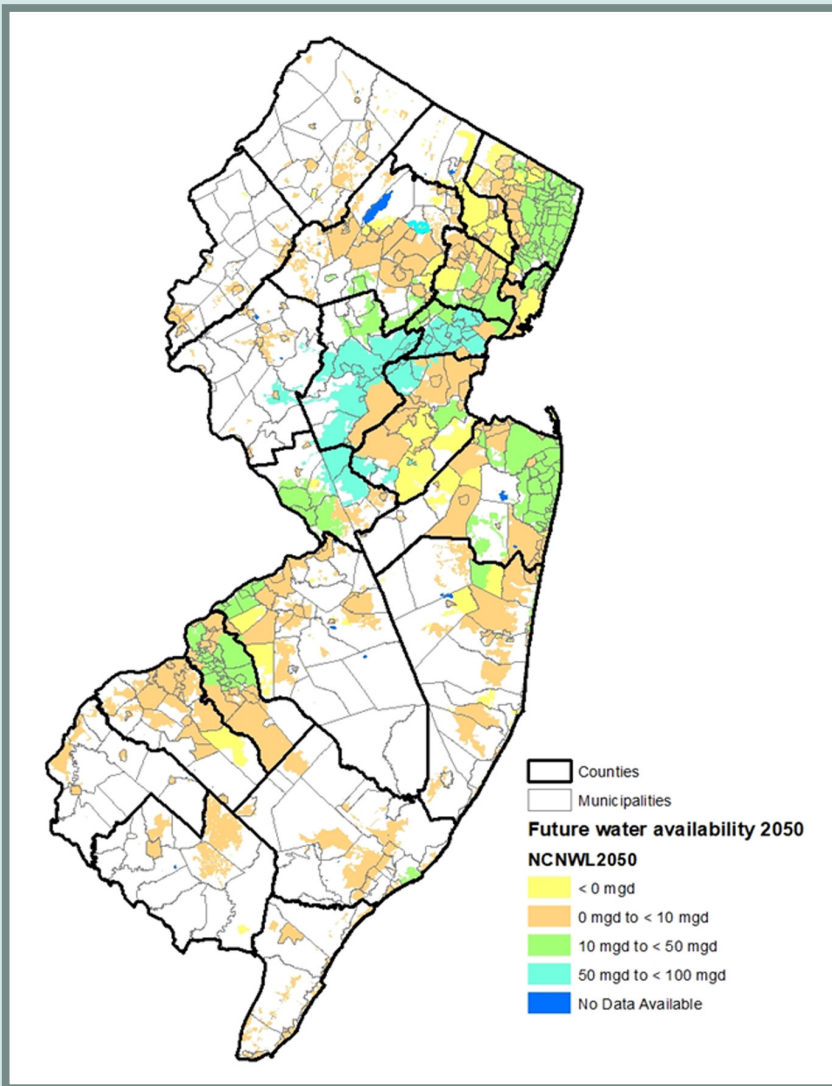


Figure K.2a Shows the projected 2050 water availability by public water system for the No Conservation Nominal Water Loss Scenario (NCNWL).

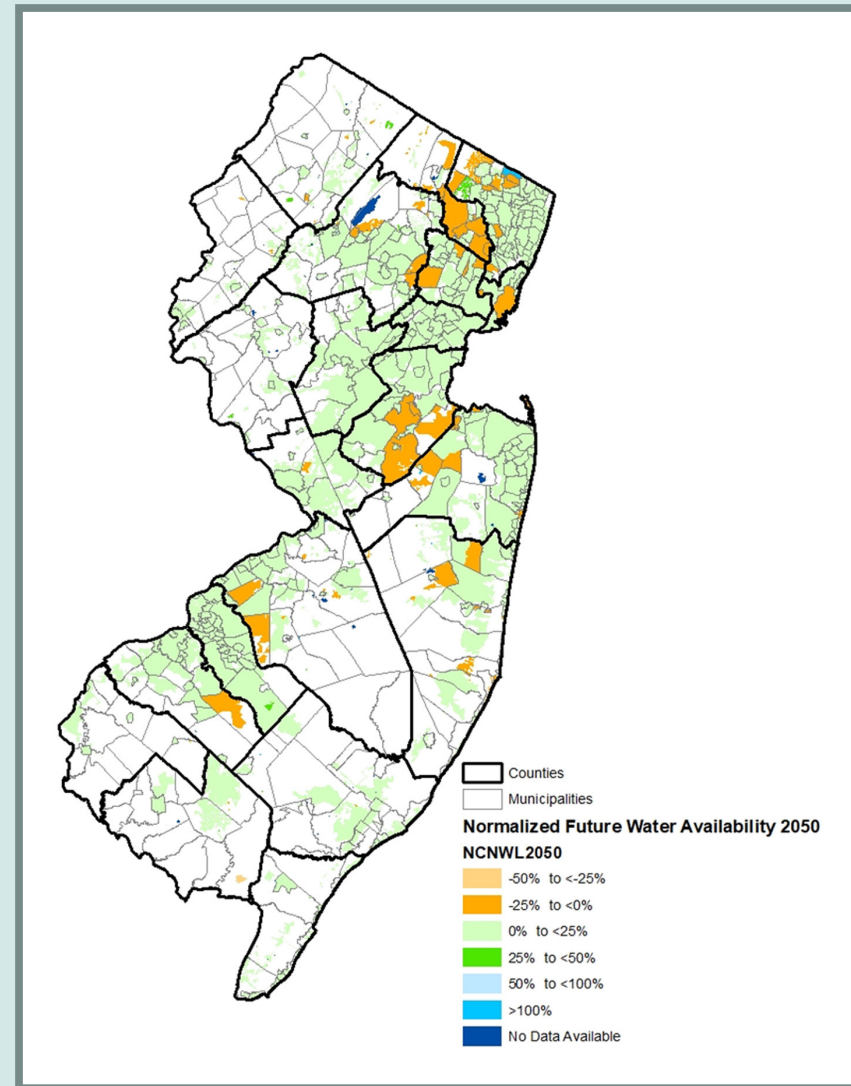


Figure K.2b Shows the projected 2050 water availability normalized by 2021 average daily demand for the NCNWL scenario.

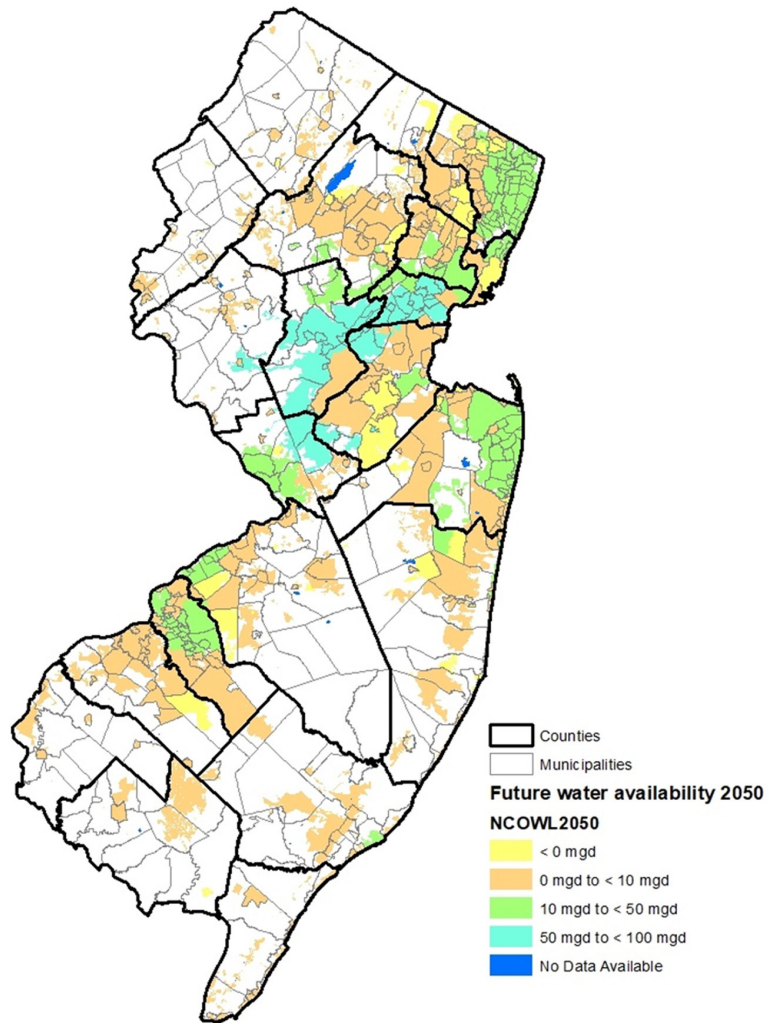


Figure K.3a Shows the projected 2050 water availability by public water system for the No Conservation Optimal Water Loss Scenario (NCOWL).

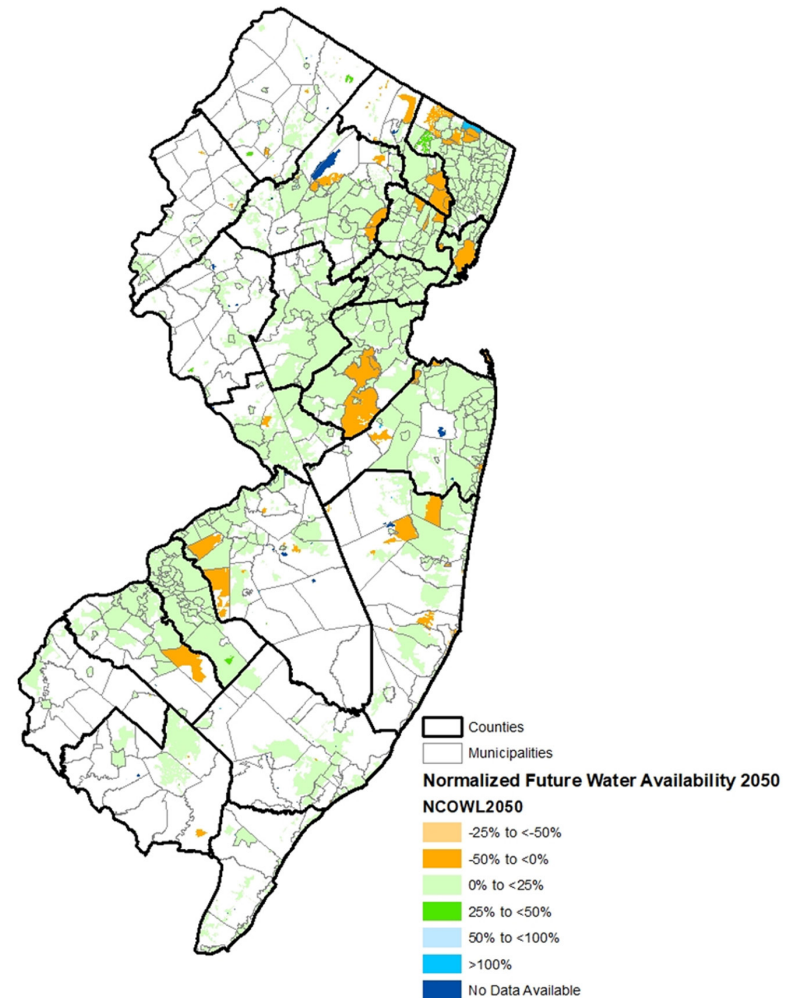


Figure K.3b Shows the projected 2050 water availability normalized by 2021 average daily demand for the NCOWL scenario.

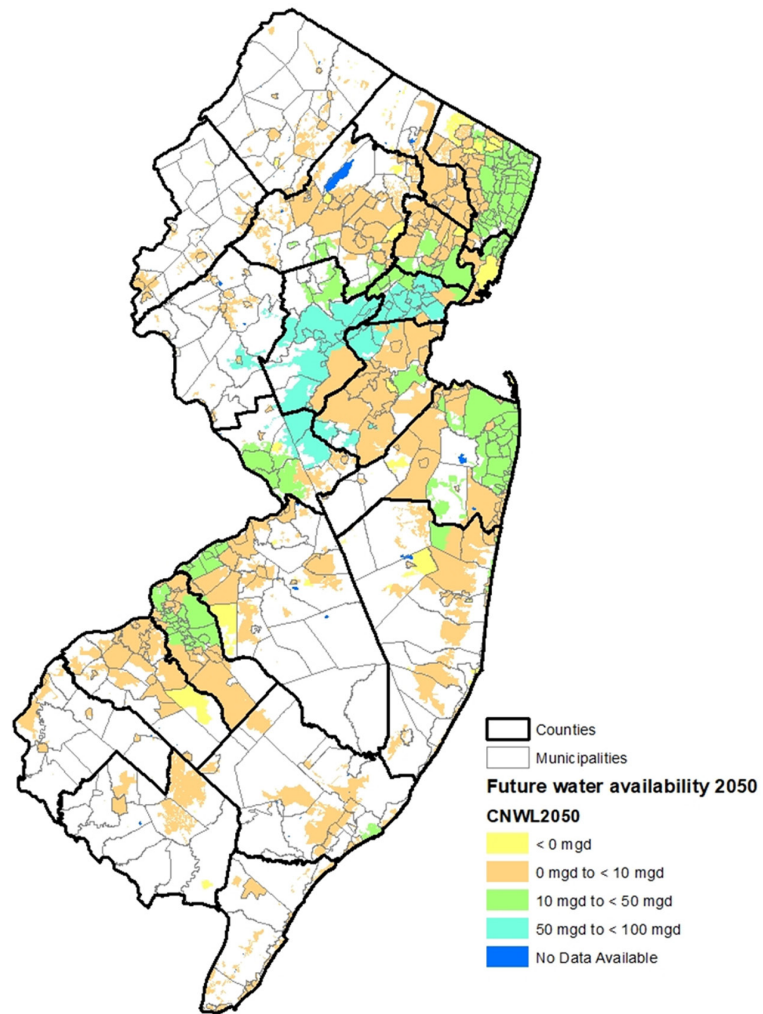


Figure K.4a Shows the projected 2050 water availability by public water system for the Conservation Nominal Water Loss Scenario (CNWL).

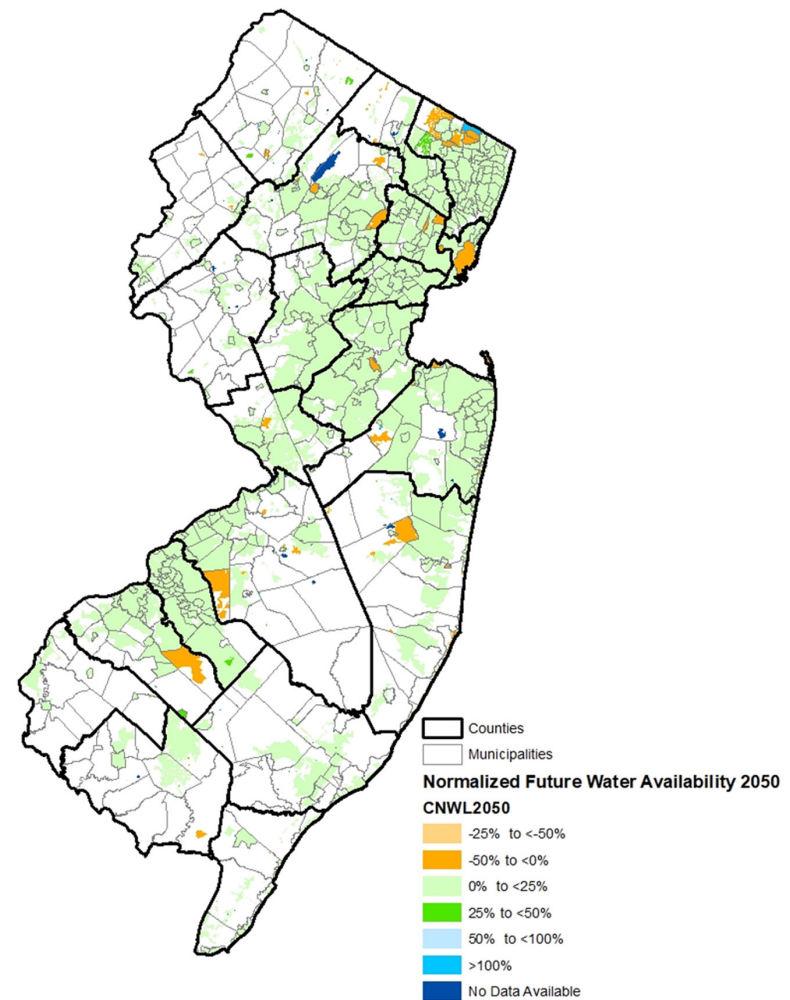


Figure K.4b Shows the projected 2050 water availability normalized by 2021 average daily demand for the CNWL scenario.

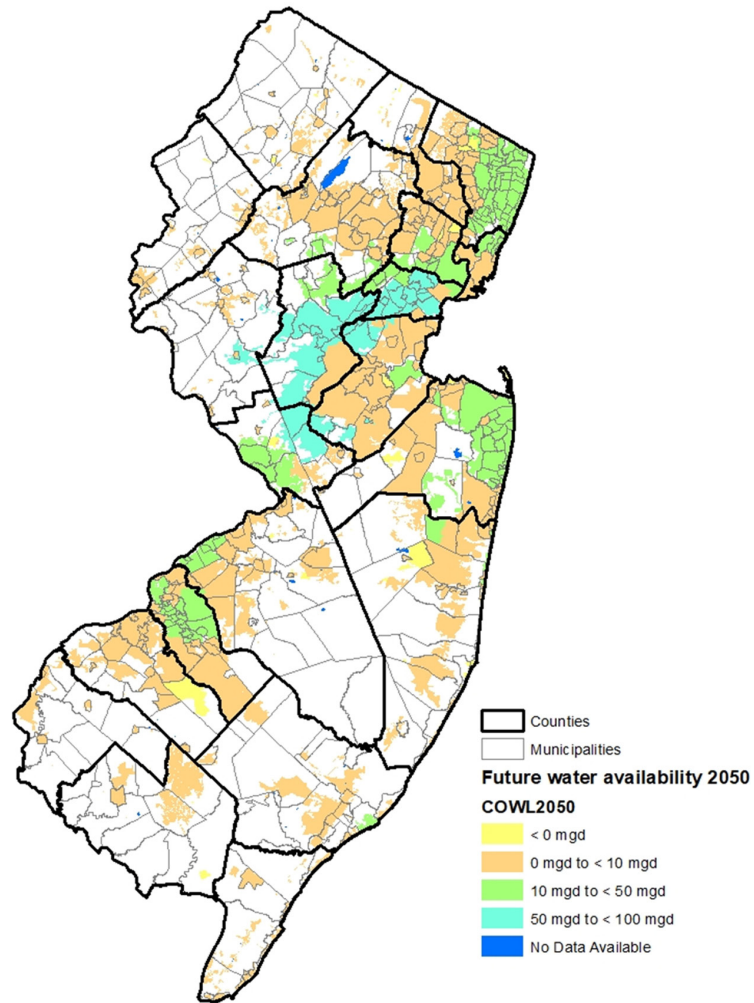


Figure K.5a Shows the projected 2050 water availability by public water system for the Conservation Optimal Water Loss Scenario (COWL).

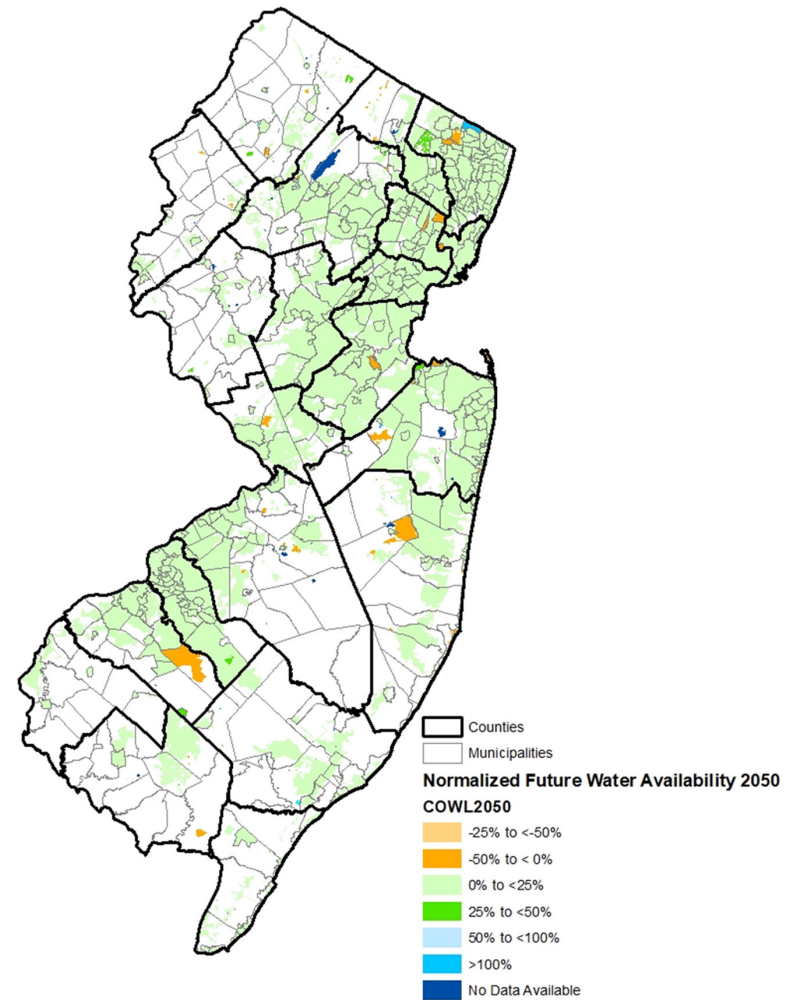


Figure K.5b Shows the projected 2050 water availability normalized by 2021 average daily demand for the COWL scenario.

Table K.6 Purveyors with 2021 surplus/deficit, Projected 2050 Future Water Availability and Normalized Water Availability

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0102001	ATLANTIC CITY MUA	12.56	12.61	13.06	13.67	14.08	1.18	1.22	1.28	1.32
NJ0103001	BRIGANTINE WATER DEPARTMENT	0.55	0.17	0.26	0.39	0.47	0.10	0.15	0.22	0.26
NJ0104003	BUENA BOROUGH MUA	0.12	0.08	0.11	0.14	0.16	0.16	0.20	0.26	0.30
NJ0105001	BUENA FAMILY MANOR MOBILE H P	0.09	0.09	0.09	0.09	0.09	13.95	14.00	14.06	14.10
NJ0105002	GARDEN HOMES MANAGEMENT CORPORATION	0.07	0.07	0.07	0.07	0.07	3.99	4.04	4.09	4.13
NJ0107001	EGG HARBOR CITY WATER DEPT	0.19	0.18	0.20	0.22	0.23	0.56	0.60	0.66	0.70
NJ0108002	ENGLISH CREEK MANOR M H PARK	0.07	0.07	0.07	0.07	0.08	3.84	3.88	3.93	3.96
NJ0108003	TILTON TERRACE MH	0.00	0.00	0.00	0.00	0.00	-0.10	-0.05	0.00	0.04
NJ0108004	NORMS DALE MOBILE HOME PARK	0.06	0.06	0.06	0.06	0.06	2.80	2.84	2.89	2.92
NJ0108005	AQUA NJ - SEAVIEW HARBOR	0.06	0.03	0.04	0.04	0.04	1.55	1.63	1.75	1.83
NJ0108006	TOWER MOBILE HOMES	0.08	0.08	0.08	0.08	0.08	6.56	6.60	6.65	6.69
NJ0108009	STONE FIELD MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108013	TOWER 1999 MOBILE HOME PARK	0.07	0.07	0.07	0.07	0.07	2.65	2.68	2.73	2.77
NJ0108014	TOWER EAST MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108019	OAK FOREST MOBILE HOME PARK	0.04	0.04	0.04	0.04	0.05	1.34	1.38	1.43	1.46
NJ0108023	EGG HARBOR RIVER RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108303	BAY BREEZE VILLAGE	0.10	0.10	0.10	0.10	0.10	112.72	112.79	112.89	112.96
NJ0111004	POMONA MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111006	SHADY PINES CAMPING RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111007	SWAN LAKE RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0112001	HAMILTON TOWNSHIP MUA	1.16	1.21	1.29	1.40	1.48	0.60	0.64	0.70	0.74
NJ0112002	BLACK HORSE MANOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0113001	HAMMONTON WATER DEPT	0.47	0.35	0.41	0.49	0.55	0.27	0.32	0.38	0.42
NJ0115001	LONGPORT WATER DEPARTMENT	-0.02	-0.03	-0.02	0.01	0.03	-0.08	-0.04	0.02	0.06

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0116001	MARGATE CITY WATER DEPARTMENT	0.49	0.15	0.22	0.32	0.39	0.10	0.15	0.23	0.27
NJ0117001	MULICA WOODS MOBILE HOME PARK	0.07	0.07	0.07	0.07	0.07	3.31	3.36	3.43	3.47
NJ0119001	DELILAH TERRACE MHP	0.08	0.08	0.08	0.08	0.08	4.34	4.38	4.44	4.48
NJ0119002	NJ AMERICAN WATER - ATLANTIC COUNTY	5.10	4.79	5.27	5.92	6.36	0.43	0.48	0.54	0.58
NJ0122001	VENTNOR CITY WATER & SEWER UTILITY	0.50	0.25	0.32	0.42	0.49	0.17	0.22	0.28	0.33
NJ0123001	WEYMOUTH TWSP MUA	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0123002	THE OAKS OF WEYMOUTH WATER CO.	0.03	0.02	0.03	0.03	0.04	0.25	0.29	0.36	0.40
NJ0201001	ALLENDAL WATER DEPT	0.24	0.12	0.17	0.22	0.26	0.15	0.20	0.27	0.31
NJ0211001	ELMWOOD PARK WATER DEPT	0.85	0.71	0.80	0.91	0.99	0.38	0.43	0.49	0.53
NJ0217001	FAIR LAWN WATER DEPT	1.69	1.35	1.53	1.75	1.92	0.37	0.42	0.48	0.52
NJ0220001	SUEZ WATER NEW JERSEY FRANKLIN LAKES	9.56	9.21	9.32	9.45	9.55	4.45	4.50	4.57	4.61
NJ0221001	GARFIELD WATER DEPARTMENT	1.32	1.00	1.15	1.33	1.47	0.33	0.38	0.44	0.48
NJ0228001	HO HO KUS WATER DEPT	0.16	0.04	0.08	0.11	0.14	0.07	0.13	0.19	0.24
NJ0231001	PASSAIC VALLEY WC LODI WD	1.76	1.65	1.74	1.85	1.93	0.89	0.93	0.99	1.04
NJ0232001	LYNDHURST WATER DEPARTMENT	0.21	-0.08	0.06	0.22	0.34	-0.03	0.02	0.08	0.13
NJ0233001	MAHWAH WATER DEPARTMENT	0.68	-0.56	-0.35	-0.12	0.07	-0.17	-0.11	-0.04	0.02
NJ0233005	BOGERTS RANCH ESTATES IN	0.00	-0.01	-0.01	0.00	0.00	-0.41	-0.34	-0.26	-0.20
NJ0236001	SUEZ WATER NEW JERSEY MONTVALE PD95	2.76	2.73	2.74	2.75	2.76	22.31	22.37	22.43	22.48
NJ0238001	SUEZ WATER NEW JERSEY HACKENSACK	22.38	16.13	21.53	27.87	32.73	0.15	0.19	0.25	0.29
NJ0239001	PVWC-NORTH ARLINGTON	2.92	2.76	2.84	2.93	2.99	1.87	1.92	1.98	2.03
NJ0242001	OAKLAND WATER DEPT	0.41	-0.03	0.07	0.18	0.27	-0.02	0.04	0.11	0.16
NJ0247001	PARK RIDGE WATER DEPT	0.09	-0.37	-0.24	-0.10	0.01	-0.17	-0.11	-0.05	0.00
NJ0248001	RAMSEY WATER DEPT	1.47	1.01	1.12	1.24	1.34	0.55	0.60	0.67	0.72
NJ0251001	RIDGEWOOD WATER	2.22	0.81	1.25	1.78	2.19	0.10	0.15	0.21	0.26

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0257001	SADDLE BROOK WATER DEPT	0.19	0.00	0.08	0.17	0.24	0.00	0.05	0.11	0.16
NJ0258001	SADDLE RIVER WATER UTILITY	-0.15	-0.19	-0.17	-0.16	-0.15	-0.85	-0.79	-0.73	-0.68
NJ0264001	WALDWICK WATER DEPT	0.14	-0.23	-0.17	-0.09	-0.03	-0.22	-0.16	-0.09	-0.03
NJ0265001	WALLINGTON WATER DEPT	0.88	0.69	0.75	0.81	0.86	0.67	0.73	0.79	0.84
NJ0301001	BUTTONWOOD MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0303001	BORDENTOWN WATER DEPARTM	0.85	0.68	0.77	0.91	1.00	0.32	0.36	0.43	0.47
NJ0305001	BURLINGTON CITY WATER DEPT	0.84	1.11	1.15	1.20	1.24	0.91	0.94	0.99	1.02
NJ0306001	BURLINGTON TWP W DEPT	0.91	0.95	1.04	1.16	1.24	0.45	0.49	0.55	0.59
NJ0307002	ALBERT C WAGNER YOUTH CORRECTIONAL FACILITY	0.29	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0311001	FENIMORE TRAILER PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0311002	FENIMORE WOODS MHP	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0313001	EVESHAM MUA	0.05	-0.49	-0.30	-0.05	0.11	-0.13	-0.08	-0.01	0.03
NJ0314001	FIELDSBORO WATER DEPARTMENT	0.08	0.08	0.08	0.08	0.08	N/A	N/A	N/A	N/A
NJ0315001	FLORENCE TWP W DEPT	0.16	0.17	0.24	0.33	0.40	0.10	0.14	0.20	0.24
NJ0318002	NJ AMERICAN WATER - HOMESTEAD	0.03	-0.04	-0.03	-0.02	-0.01	-0.23	-0.18	-0.09	-0.04
NJ0319001	MAPLE SHADE WATER DEPARTMENT	0.16	0.50	0.57	0.65	0.71	0.27	0.30	0.35	0.38
NJ0320001	MEDFORD TWP DEPT OF MUNI	0.70	0.56	0.63	0.73	0.79	0.37	0.42	0.48	0.52
NJ0320002	ESTAUGH CORP T/A MEDFORD LEAS	0.00	-0.03	-0.03	-0.02	-0.02	-0.41	-0.35	-0.27	-0.22
NJ0322001	MOORESTOWN WATER DEPT	0.23	-0.26	-0.10	0.11	0.25	-0.08	-0.03	0.03	0.08
NJ0323001	NJ AMERICAN WATER - MOUNT HOLLY	1.94	1.63	1.84	2.12	2.31	0.36	0.40	0.46	0.50
NJ0324001	MT LAUREL TWP MUA	0.19	0.10	0.30	0.57	0.75	0.02	0.07	0.12	0.16
NJ0325001	JBMDL-DIX MAIN SYSTEM	2.97	4.04	4.07	4.11	4.14	2.27	2.29	2.31	2.33
NJ0326001	AQUA NJ - CALIFORNIA VILLAGE	0.07	0.07	0.07	0.07	0.07	N/A	N/A	N/A	N/A
NJ0326003	HANOVER EAST APARTMENTS	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0326004	AQUA NJ - HANOVER MOBILE VILLAGE	0.04	0.01	0.01	0.02	0.02	0.26	0.34	0.43	0.50
NJ0326005	CEDAR GROVE APARTMENTS	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0326006	JOINT BASE MDL MCGUIRE AREA	0.47	0.47	0.50	0.54	0.57	0.65	0.69	0.75	0.79
NJ0326007	SOUTHS MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0326008	AQUA NJ INC - SPARTAN VILLAGE	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ0326009	WAGON WHEEL ESTATES	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0326012	MILLSTREAM APTS	0.08	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0326013	MILLSTREAM APTS	0.04	0.04	0.04	0.04	0.04	3.09	3.15	3.23	3.28
NJ0326014	FAMILY PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0327001	NJ AMERICAN WATER - WESTERN DIVISION	23.36	23.41	25.27	27.77	29.45	0.53	0.58	0.63	0.67
NJ0328001	PEMBERTON BOROUGH WATER	0.08	0.08	0.09	0.10	0.10	0.59	0.63	0.69	0.73
NJ0329001	BURLINGTON COUNTY INSTIT	-0.02	-0.04	-0.03	-0.03	-0.02	-0.51	-0.45	-0.38	-0.33
NJ0329002	HILLTOP MOBILE VILLAGE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0329003	PEMBERTON TOWNSHIP WATER - LAKE VALLEY	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0329004	PEMBERTON TWP DEPT MAIN	0.69	0.68	0.71	0.76	0.78	0.88	0.93	0.99	1.02
NJ0329005	PINEVIEW TERRACE INCORPORATED	0.03	0.02	0.02	0.02	0.03	0.95	1.01	1.08	1.14
NJ0329006	NJ AMERICAN WATER - SUNBURY	0.05	0.05	0.05	0.05	0.06	0.63	0.68	0.74	0.77
NJ0329008	PINEFIELD APARTMENTS	0.09	0.09	0.09	0.09	0.09	11.65	11.71	11.79	11.84
NJ0329009	PEMBERTON TWP WATER DEPT - PEMBERTON HEIGHTS	-0.07	-0.06	-0.06	-0.06	-0.06	-2.35	-2.31	-2.26	-2.22
NJ0332001	FAWN LAKE VILLAGE	0.07	0.07	0.07	0.07	0.07	4.24	4.29	4.37	4.41
NJ0332002	OAKVIEW LEISURE VILLAGE	0.08	0.08	0.08	0.08	0.08	5.63	5.68	5.75	5.80
NJ0333001	PINELANDS WATER CO	0.27	0.24	0.26	0.29	0.30	0.58	0.63	0.69	0.73
NJ0333002	MOBILE ESTATES OF SOUTH A	0.02	0.02	0.02	0.03	0.03	0.35	0.39	0.45	0.48
NJ0333003	RICHARDS MOBILE HOME COURT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0333004	NJ AMERICAN WATER -VINCENTOWN	0.04	0.04	0.05	0.05	0.05	0.93	0.97	1.03	1.07
NJ0335001	ALLENWOOD MOBILE ESTATES	0.09	0.09	0.09	0.09	0.09	19.52	19.57	19.62	19.66
NJ0338001	WILLINGBORO MUA	1.75	2.18	2.32	2.51	2.63	0.58	0.62	0.67	0.71
NJ0339001	NEW LISBON DEVELOPMENT CTR	0.11	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0340001	WRIGHTSTOWN MUA	0.10	0.07	0.07	0.08	0.08	1.09	1.15	1.24	1.29
NJ0340002	MAPLEWOOD APARTMENTS	0.08	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0404001	BELLMAWR WATER DEPT	0.11	0.15	0.19	0.23	0.26	0.18	0.22	0.27	0.31
NJ0405001	BERLIN WATER DEPARTMENT	0.37	0.31	0.35	0.40	0.44	0.38	0.42	0.48	0.52
NJ0407001	BROOKLAWN WATER DEPARTMENT	0.06	0.04	0.04	0.06	0.06	0.20	0.25	0.31	0.35
NJ0408001	CITY OF CAMDEN	7.68	10.49	10.84	11.32	11.64	0.94	0.97	1.02	1.05
NJ0410001	TOWN & COUNTRY MHP	0.08	0.08	0.08	0.08	0.08	5.18	5.24	5.31	5.37
NJ0410002	BNAI BRITH CHESILHURST HOUSE	0.09	0.09	0.09	0.09	0.09	29.80	29.80	29.80	29.80
NJ0411001	CLEMENTON WATER DEPARTMENT	0.35	0.38	0.40	0.43	0.45	0.72	0.76	0.82	0.85
NJ0412001	COLLINGSWOOD WATER DEPAR	0.17	0.34	0.41	0.52	0.58	0.17	0.21	0.26	0.30
NJ0414001	GLOUCESTER CITY WATER DEPARTMENT	0.56	0.59	0.62	0.67	0.70	0.70	0.74	0.80	0.83
NJ0415002	AQUA NJ - BLACKWOOD	1.11	0.87	1.04	1.27	1.43	0.23	0.28	0.34	0.38
NJ0416001	HADDON TWP WATER DEPARTM	0.31	0.41	0.45	0.50	0.53	0.42	0.46	0.51	0.54
NJ0424001	MERCHANTVILLE PENNSAUKEN	1.22	1.37	1.62	1.96	2.19	0.22	0.27	0.32	0.36
NJ0428002	PINE HILL BOROUGH MUA	0.62	0.59	0.63	0.67	0.70	0.74	0.79	0.85	0.89
NJ0429001	PINE VALLEY GOLF CLUB	-0.55	-0.55	-0.55	-0.55	-0.55	-2.49	-2.49	-2.49	-2.49
NJ0435003	WATERFORD TOWNSHIP WATER DEPT.	0.41	0.36	0.37	0.38	0.39	1.59	1.64	1.71	1.76
NJ0435324	PARKWOODS CARE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0436001	ANCORA PSYCHIATRIC HOSPI	0.56	0.80	0.80	0.80	0.80	3.18	3.18	3.18	3.18
NJ0436002	ELMTOWNE VILLAGE ASSOC SYS 1	0.08	0.07	0.07	0.08	0.08	5.23	5.29	5.37	5.42

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0436007	WINSLOW TWP DMU	2.04	1.97	2.07	2.21	2.30	0.84	0.88	0.94	0.98
NJ0436008	WINSLOW TWP DMU	0.06	0.05	0.05	0.05	0.06	1.93	1.98	2.06	2.11
NJ0436009	ELMTOWNE VILLAGE ASSOC. SYS 2	0.08	0.07	0.07	0.08	0.08	5.23	5.29	5.36	5.42
NJ0436010	WINSLOW COURT HOMES INC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0501001	AVALON WATER AND SEWERAGE UTILITIES	0.24	0.20	0.25	0.32	0.36	0.18	0.22	0.28	0.32
NJ0502001	CAPE MAY WATER & SEWER UTILITY	0.72	0.47	0.55	0.65	0.72	0.30	0.35	0.41	0.46
NJ0503001	CAPE MAY POINT BORO WATER DEPARTMENT	0.01	0.02	0.02	0.02	0.03	0.18	0.22	0.27	0.31
NJ0504306	OCEAN VIEW ASSO OPERATION LLC DBA AUTUMN LAKE	0.07	0.07	0.07	0.07	0.07	3.45	3.49	3.55	3.59
NJ0505002	LOWER TWP MUA	0.11	0.18	0.25	0.33	0.39	0.12	0.16	0.21	0.25
NJ0505003	CAPE MAY MOBILE ESTATES	0.07	0.07	0.07	0.07	0.07	8.28	8.34	8.41	8.46
NJ0506001	DELSEA WOODS COMMUNITY LLC	0.07	0.07	0.07	0.07	0.07	3.86	3.91	3.97	4.02
NJ0506004	EDGEWOOD VILLAGE M H PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0506007	GRANDE WOODS SOUTH MOBILE H P	0.05	0.05	0.05	0.05	0.06	1.59	1.63	1.68	1.72
NJ0506008	MIDDLE TWP WATER DISTRICT 1	0.05	0.04	0.04	0.05	0.05	1.50	1.56	1.63	1.68
NJ0506009	MIDDLE TWP WATER DISTRICT #2	0.01	0.00	0.00	0.01	0.01	0.02	0.07	0.14	0.18
NJ0506010	NJ AMERICAN WATER - CAPE MAY COURT HOUSE	0.27	0.37	0.40	0.44	0.46	0.47	0.51	0.56	0.59
NJ0506012	PRESIDENTIAL COURTS MOBILE H P	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0506013	A AND J MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0506015	GRANDE WOODS NORTH MHP	0.07	0.07	0.07	0.07	0.07	3.97	4.01	4.06	4.10
NJ0506321	CEDAR SPRINGS MHP WELL #	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0508001	NJ AMERICAN WATER - OCEAN CITY	1.21	1.12	1.25	1.41	1.52	0.40	0.45	0.51	0.55
NJ0509001	SEA ISLE CITY WATER DEPARTMENT	0.31	0.32	0.35	0.40	0.43	0.40	0.44	0.50	0.54
NJ0510001	STONE HARBOR WATER DEPT	0.14	0.12	0.15	0.18	0.21	0.21	0.25	0.31	0.35

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0511001	NJ AMERICAN WATER - STRATHMERE	0.03	-0.49	-0.47	-0.43	-0.41	-8.62	-8.19	-7.61	-7.23
NJ0511003	SHORE ACRES MOBILE HOME	0.06	0.05	0.05	0.05	0.05	2.31	2.36	2.43	2.48
NJ0512001	WEST CAPE MAY WATER DEPT	-0.01	0.01	0.01	0.02	0.02	0.05	0.09	0.14	0.18
NJ0514001	WILDWOOD CITY WATER DEPARTMENT	1.14	1.23	1.40	1.62	1.77	0.31	0.35	0.40	0.44
NJ0516001	WOODBINE MUA	0.21	0.19	0.20	0.22	0.23	0.66	0.71	0.77	0.81
NJ0516003	CAROL LYNN RESORTS, INC.	0.09	0.09	0.09	0.09	0.09	10.90	10.96	11.04	11.10
NJ0601001	BRIDGETON CITY WATER DEPT	1.12	0.56	0.71	0.91	1.04	0.19	0.24	0.31	0.36
NJ0604001	BAYVIEW WATER SYSTEM	0.06	0.05	0.06	0.06	0.06	2.70	2.76	2.85	2.91
NJ0605001	FAIRTON OAKS M H COMMUNITY	0.08	0.07	0.07	0.08	0.08	5.59	5.66	5.75	5.81
NJ0605002	TIPS TRAILER PARK & SALE	0.05	0.04	0.04	0.05	0.05	1.21	1.27	1.34	1.40
NJ0605004	FAIRTON FEDERAL CORRECTIONAL INSTITUTION	0.16	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0607001	HOPEWELL PLACE SENIOR APTS	0.08	0.07	0.07	0.07	0.07	6.03	6.11	6.23	6.30
NJ0609001	NJ STATE PRISON BAYSIDE	-0.01	-1.88	-1.77	-1.62	-1.52	-2.52	-2.37	-2.17	-2.03
NJ0610001	MILLVILLE WATER DEPARTMENT	1.46	1.45	1.60	1.81	1.94	0.41	0.45	0.51	0.55
NJ0610002	COUNTRY MEADOWS RENTS AND SALES MHP LLC	0.07	0.07	0.07	0.07	0.07	3.05	3.10	3.16	3.20
NJ0612001	BAYSHORE MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0613004	UPPER DEERFIELD TWP WATER DEPT	0.50	0.47	0.50	0.53	0.55	0.85	0.90	0.96	1.00
NJ0614002	PARKWOOD BRANCH TERRACES	0.01	-0.02	-0.01	-0.01	-0.01	-0.26	-0.20	-0.13	-0.07
NJ0614003	VINELAND WATER & SEWER UTILITY	2.00	1.57	1.90	2.36	2.66	0.21	0.25	0.32	0.36
NJ0614004	CHAPMAN MANUFACTURED HOUSING	0.08	0.07	0.07	0.07	0.08	4.11	4.17	4.24	4.30
NJ0614005	UNITED MOBILE HOMES OF VINELAND	0.01	-0.07	-0.06	-0.05	-0.04	-0.59	-0.51	-0.42	-0.35
NJ0701001	BELLEVILLE WATER DEPT	1.06	0.56	0.76	0.99	1.17	0.15	0.20	0.26	0.31
NJ0702001	BLOOMFIELD WATER DEPARTMENT	1.78	1.55	1.80	2.10	2.33	0.29	0.34	0.40	0.44
NJ0703001	CALDWELL WATER DEPT	0.17	0.17	0.21	0.26	0.29	0.21	0.26	0.31	0.35

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0704001	CEDAR GROVE WATER DEPT	0.07	-0.11	-0.03	0.05	0.12	-0.08	-0.02	0.04	0.08
NJ0705001	EAST ORANGE WATER COMMISSION	6.95	6.76	7.10	7.50	7.81	0.93	0.98	1.03	1.08
NJ0706001	ESSEX FELS WATER DEPT	0.21	0.72	0.84	0.99	1.10	0.22	0.26	0.31	0.34
NJ0706002	ESSEX FELS WATER HILLTOP SYSTEM	0.14	0.13	0.13	0.14	0.14	1.29	1.35	1.41	1.46
NJ0707001	FAIRFIELD WATER DEPT	0.40	0.28	0.34	0.41	0.46	0.24	0.29	0.35	0.39
NJ0708001	GLEN RIDGE WATER DEPT	-0.64	-0.75	-0.70	-0.65	-0.61	-0.82	-0.77	-0.71	-0.66
NJ0710001	LIVINGSTON TWP DIV OF WATER	0.29	-0.07	0.14	0.38	0.56	-0.02	0.03	0.09	0.14
NJ0712001	NJ AMERICAN WATER - PASSAIC BASIN	11.49	12.54	14.34	16.37	17.98	0.31	0.36	0.41	0.45
NJ0713001	MONTCLAIR WATER BUREAU	1.52	1.16	1.46	1.81	2.08	0.19	0.24	0.30	0.34
NJ0714001	NEWARK WATER DEPARTMENT	27.08	41.53	44.33	45.51	48.13	0.55	0.59	0.60	0.64
NJ0715001	NORTH CALDWELL WATER DEP	0.40	0.35	0.39	0.45	0.49	0.35	0.40	0.46	0.50
NJ0715002	NORTH CALDWELL - HILLTOP	0.09	0.08	0.09	0.09	0.10	0.84	0.89	0.95	1.00
NJ0716001	NUTLEY WATER DEPT	-0.84	-1.03	-0.86	-0.67	-0.51	-0.30	-0.25	-0.19	-0.15
NJ0717001	ORANGE WATER DEPT	-0.30	0.29	0.42	0.58	0.70	0.08	0.12	0.17	0.20
NJ0718001	ROSELAND WATER DEPT	0.07	0.01	0.05	0.10	0.13	0.02	0.07	0.12	0.17
NJ0719001	SOUTH ORANGE WATER DEPARTMENT	0.27	0.24	0.35	0.47	0.57	0.10	0.15	0.20	0.25
NJ0720001	VERONA WATER DEPARTMENT	1.18	1.07	1.15	1.24	1.30	0.69	0.74	0.80	0.84
NJ0721001	WEST CALDWELL WATER DEPARTMENT	0.07	0.37	0.42	0.47	0.52	0.27	0.30	0.35	0.38
NJ0801001	CLAYTON WATER DEPARTMENT	0.20	0.13	0.16	0.20	0.23	0.20	0.24	0.31	0.35
NJ0802001	DEPTFORD TWP MUA	0.46	0.62	0.72	0.86	0.96	0.23	0.27	0.33	0.36
NJ0803001	EAST GREENWICH TWP WATER DEPT	0.20	0.23	0.27	0.32	0.36	0.23	0.27	0.33	0.37
NJ0804001	LAUX LAKEVIEW MOBILE H P INC	0.05	0.04	0.04	0.04	0.05	1.12	1.18	1.26	1.31
NJ0804308	OLDMANS CREEK CAMPGROUND	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0805001	IONA TRAILER PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0805002	MALAGA MOBILE LLC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0805003	MALAGA VILLA APARTMENTS	0.09	0.09	0.09	0.09	0.09	16.71	16.76	16.81	16.85
NJ0805433	HOLLY GREEN CAMPGROUND	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0806001	GLASSBORO WATER DEPARTMENT	0.78	0.95	1.05	1.18	1.27	0.38	0.42	0.48	0.51
NJ0807001	GREENWICH TWP W DEPT	0.31	0.31	0.34	0.38	0.40	0.48	0.52	0.58	0.62
NJ0808001	NJ AMERICAN WATER - HARRISON	0.36	0.02	0.08	0.16	0.22	0.02	0.08	0.15	0.20
NJ0809001	NJ AMERICAN WATER - BRIDGEPORT	0.20	0.16	0.16	0.17	0.18	1.96	2.02	2.11	2.16
NJ0809002	NJ AMERICAN WATER - LOGAN	0.37	0.47	0.53	0.61	0.66	0.30	0.34	0.39	0.42
NJ0810004	MANTUA TOWNSHIP MUA	0.39	0.23	0.28	0.36	0.40	0.21	0.26	0.33	0.37
NJ0810005	MANOR WATER ASSOCIATIONS	0.09	0.08	0.08	0.08	0.09	13.57	13.62	13.69	13.73
NJ0811002	MONROE TWP MUA	0.07	-0.46	-0.33	-0.15	-0.03	-0.18	-0.13	-0.06	-0.01
NJ0812001	NATIONAL PARK WATER DEPARTMENT	0.07	0.09	0.10	0.11	0.11	0.44	0.48	0.53	0.56
NJ0813001	NEWFIELD WATER DEPARTMENT	0.35	0.36	0.37	0.37	0.38	2.45	2.49	2.54	2.58
NJ0814001	PAULSBORO WATER DEPARTMENT	0.32	0.47	0.49	0.52	0.53	0.75	0.78	0.83	0.86
NJ0815001	PITMAN WATER DEPARTMENT	0.22	0.16	0.19	0.22	0.25	0.28	0.33	0.39	0.43
NJ0816001	HARRISONVILLE MOBILE HOME PARK	0.01	0.00	0.01	0.01	0.01	0.08	0.13	0.19	0.23
NJ0817001	SWEDESBORO WATER DEPARTMENT	0.16	0.15	0.16	0.17	0.18	0.67	0.72	0.78	0.82
NJ0818004	WASHINGTON TOWNSHIP MUA	1.68	1.18	1.38	1.64	1.82	0.29	0.34	0.40	0.44
NJ0819001	WENONAH WATER DEPARTMENT	0.04	0.04	0.05	0.06	0.06	0.23	0.27	0.33	0.37
NJ0820001	WEST DEPTFORD TWP WATER DEPT	0.52	0.09	0.21	0.38	0.49	0.03	0.08	0.15	0.20
NJ0821001	WESTVILLE WATER DEPARTMENT	0.03	0.05	0.07	0.10	0.12	0.11	0.15	0.20	0.24
NJ0822001	WOODBURY CITY W DEPT	0.30	0.31	0.36	0.42	0.46	0.28	0.32	0.38	0.42
NJ0823001	WOODBURY HEIGHTS W UTILITY	0.16	0.16	0.17	0.18	0.19	0.75	0.79	0.85	0.89
NJ0824001	AQUA NJ - WOOLWICH	0.54	0.07	0.12	0.18	0.22	0.12	0.19	0.30	0.36

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0901001	BAYONNE MUA	0.41	0.02	0.45	0.95	1.34	0.00	0.05	0.11	0.15
NJ0902001	EAST NEWARK W DEPT	-0.34	-0.43	-0.41	-0.39	-0.37	-1.56	-1.49	-1.42	-1.37
NJ0904001	HARRISON WATER DEPARTMENT	0.03	-0.99	-0.87	-0.73	-0.62	-0.61	-0.54	-0.45	-0.38
NJ0905001	HOBOKEN WATER DEPT	0.71	0.87	1.08	1.32	1.51	0.19	0.23	0.28	0.32
NJ0906001	JERSEY CITY MUA	7.19	-6.24	-3.53	-0.35	2.08	-0.14	-0.08	-0.01	0.05
NJ0907001	KEARNY WATER DEPARTMENT	6.25	5.49	5.79	6.14	6.41	0.95	1.01	1.07	1.11
NJ1001301	VALLEYVIEW HEALTHCARE & REHABILITATION CENTER	0.08	0.07	0.07	0.08	0.08	1.01	1.06	1.12	1.17
NJ1004001	AQUA NJ INC - CALIFON	0.32	0.43	0.51	0.61	0.68	0.23	0.27	0.32	0.36
NJ1005001	CLINTON W DEPT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1006300	TEEN CHALLENGE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1006302	ROLLING HILLS CARE CENTER	0.04	0.04	0.04	0.04	0.04	0.75	0.80	0.86	0.91
NJ1007001	DELAWARE TOWNSHIP MUA	0.06	0.06	0.06	0.06	0.06	3.17	3.21	3.27	3.31
NJ1007002	ROSEMONT WATER DEPARTMENT	0.20	0.20	0.22	0.25	0.28	0.35	0.40	0.46	0.50
NJ1009001	FLEMINGTON WATER DEPARTMENT	0.12	0.12	0.13	0.13	0.14	1.15	1.20	1.25	1.29
NJ1011001	NJ AMERICAN WATER - FRENCHTOWN	0.06	0.06	0.06	0.07	0.07	0.67	0.72	0.77	0.82
NJ1012001	GLEN GARDNER W DEPT	0.03	0.07	0.07	0.08	0.08	0.56	0.59	0.63	0.66
NJ1013001	HAMPTON BOROUGH WATER DEPARTMENT	-0.05	0.24	0.25	0.26	0.27	0.44	0.46	0.48	0.50
NJ1014001	HIGH BRIDGE W DEPT	0.03	0.02	0.03	0.03	0.03	0.44	0.49	0.55	0.60
NJ1015003	AQUA NJ INC - RIEGEL RIDGE	0.00	0.00	0.00	0.00	0.00	0.13	0.18	0.23	0.28
NJ1015004	AQUA NJ - FOX HILL	0.37	0.43	0.44	0.46	0.47	1.48	1.52	1.56	1.60
NJ1017001	SUEZ WATER NEW JERSEY LAMBERTVILLE	0.05	0.05	0.05	0.05	0.05	2.27	2.32	2.38	2.43
NJ1019001	AQUA NJ INC - BUNNVALE	0.03	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1019002	HAGEDORN PSYCIATRIC HOSPITAL	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1019003	CAMELOT AT SPRUCE RIDGE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1019301	HUNTERDON HILL RCF	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1019311	LITTLE BROOK NURSING HOM	0.11	0.09	0.10	0.11	0.11	0.72	0.77	0.83	0.88
NJ1020001	MILFORD W DEPT	0.04	0.04	0.04	0.04	0.04	1.13	1.18	1.23	1.27
NJ1021363	HUNTERDON CARE CENTER	0.04	0.03	0.04	0.04	0.05	0.29	0.34	0.40	0.45
NJ1023001	STOCKTON WATER DEPARTMENT	0.07	0.07	0.07	0.07	0.07	3.84	3.90	3.96	4.01
NJ1024001	NJ AMERICAN WATER - OLDWICK	-0.01	0.14	0.15	0.15	0.16	0.59	0.61	0.63	0.64
NJ1025001	EDNA MAHAN CORRECTIONAL	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1025313	COUNTRY ARCH CARE CENTER	0.02	0.02	0.02	0.02	0.02	0.66	0.72	0.80	0.85
NJ1101002	EAST WINDSOR MUA	0.87	0.99	1.10	1.25	1.34	0.37	0.41	0.47	0.50
NJ1103001	AQUA NJ - HAMILTON SQUARE	1.64	2.11	2.27	2.46	2.61	0.53	0.57	0.62	0.65
NJ1104001	HIGHTSTOWN WATER DEPARTMENT	0.35	0.31	0.34	0.37	0.40	0.51	0.56	0.62	0.66
NJ1105001	HOPEWELL BORO W DEPT	0.06	0.06	0.07	0.08	0.09	0.33	0.37	0.43	0.47
NJ1106001	HOPEWELL TOWNSHIP WATER & SEWER	0.01	0.00	0.01	0.01	0.01	0.03	0.08	0.14	0.18
NJ1106002	MERCER COUNTY CORRECTIONAL CEN	-0.04	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1107001	LAWRENCEVILLE SCHOOL	0.05	0.02	0.02	0.03	0.03	0.18	0.24	0.31	0.37
NJ1107002	AQUA NJ - LAWRENCE	0.06	-0.19	-0.14	-0.09	-0.05	-0.27	-0.20	-0.13	-0.08
NJ1108001	PENNINGTON W DEPT	0.12	0.12	0.13	0.15	0.16	0.54	0.58	0.63	0.67
NJ1111001	TRENTON WATER WORKS	12.55	13.88	15.05	16.43	17.49	0.52	0.56	0.61	0.65
NJ1204001	EAST BRUNSWICK TWP WATER & SEWER UTILITY	0.71	-0.49	-0.14	0.32	0.63	-0.07	-0.02	0.05	0.09
NJ1205001	NJ AMERICAN WATER - EDISON SYSTEM	7.23	7.44	7.72	8.05	8.31	1.18	1.22	1.28	1.32
NJ1206001	HELMETTA WATER DEPT	0.05	0.06	0.06	0.07	0.08	0.35	0.39	0.45	0.49
NJ1207001	HIGHLAND PARK W DEPT	0.20	0.19	0.27	0.35	0.42	0.12	0.17	0.22	0.27
NJ1209002	OLD BRIDGE MUA	1.04	-0.18	0.15	0.60	0.90	-0.03	0.02	0.09	0.14
NJ1212001	MILLTOWN W DEPT	0.26	0.23	0.26	0.30	0.32	0.38	0.42	0.48	0.52

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1213002	MONROE TOWNSHIP UTILITY DEPARTMENT	0.20	-0.53	-0.29	0.03	0.25	-0.11	-0.06	0.01	0.05
NJ1213321	JAMESBURG MANOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1214001	NEW BRUNSWICK WATER DEPARTMENT	3.54	1.57	2.32	3.19	3.86	0.11	0.16	0.22	0.27
NJ1215001	NORTH BRUNSWICK WATER DEPARTMENT	1.26	0.73	1.00	1.32	1.57	0.13	0.19	0.24	0.29
NJ1216001	PERTH AMBOY WATER DEPARTMENT	0.63	1.87	2.09	2.34	2.54	0.31	0.35	0.39	0.42
NJ1219001	SAYREVILLE W DEPT	10.34	11.22	11.58	11.74	12.08	1.21	1.25	1.27	1.30
NJ1221004	SOUTH BRUNSWICK TOWNSHIP WATER DIVISION	2.33	0.63	0.97	1.37	1.67	0.11	0.17	0.24	0.30
NJ1223001	SOUTH RIVER W DEPT	-0.61	-0.68	-0.62	-0.54	-0.49	-0.54	-0.49	-0.43	-0.39
NJ1224001	SPOTSWOOD W DEPT	0.17	0.12	0.15	0.19	0.21	0.18	0.23	0.29	0.33
NJ1225001	MIDDLESEX WATER COMPANY	8.21	1.47	3.81	6.57	8.67	0.03	0.09	0.15	0.20
NJ1302001	ALLENTOWN WATER DEPT	0.09	0.09	0.09	0.10	0.11	0.52	0.56	0.62	0.65
NJ1304001	ATLANTIC HIGHLANDS WATER	0.14	0.11	0.13	0.15	0.17	0.28	0.32	0.38	0.43
NJ1305001	AVON BY THE SEA WATER DE	0.00	0.00	0.01	0.03	0.04	0.01	0.05	0.11	0.14
NJ1306001	BELMAR WATER DEPT	-0.03	-0.07	-0.03	0.01	0.05	-0.09	-0.04	0.02	0.06
NJ1308001	BRIELLE WATER DEPT	0.01	0.01	0.03	0.07	0.09	0.01	0.06	0.11	0.15
NJ1309001	US NAVAL WEAPONS STATION	-0.36	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1309002	S B WATER COMPANY	-0.14	-0.15	-0.15	-0.14	-0.14	-2.11	-2.06	-2.00	-1.95
NJ1309415	BRANDYWINE ASSISTED LIVING AT COLTS NECK	0.08	0.08	0.08	0.08	0.08	10.06	10.06	10.06	10.06
NJ1312001	ENGLISHTOWN WATER DEPT	-0.01	0.02	0.03	0.04	0.05	0.09	0.13	0.18	0.21
NJ1314001	FARMINGDALE WATER DEPT	0.05	0.06	0.07	0.08	0.08	0.43	0.47	0.53	0.56
NJ1315001	FREEHOLD BOROUGH WATER DEPARTMENT	0.46	0.41	0.46	0.53	0.58	0.33	0.37	0.43	0.47
NJ1316001	FREEHOLD TWP WATER DEPT	1.03	0.48	0.68	0.96	1.14	0.11	0.16	0.23	0.27
NJ1319003	ANGLE INN MOTOR COURT	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1319007	PARKWAY WATER COMPANY	0.64	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1319008	WINDING BROOK MHP SYS 1	0.08	0.08	0.08	0.08	0.08	8.56	8.60	8.66	8.70
NJ1319009	WINDING BROOK MHP SYSTEM 2	0.08	0.07	0.08	0.08	0.08	4.45	4.49	4.55	4.59
NJ1319010	GREEN ACRES NJ MHC LLC	0.06	0.06	0.06	0.06	0.07	2.50	2.54	2.59	2.62
NJ1321001	KEANSBURG WATER & SEWER DEPT.	0.27	0.20	0.23	0.28	0.32	0.25	0.29	0.36	0.40
NJ1322001	KEYPORT WATER DEPT	0.25	0.22	0.24	0.28	0.30	0.37	0.41	0.47	0.51
NJ1326001	GORDONS CORNER WATER CO	0.16	-0.14	0.08	0.39	0.59	-0.03	0.02	0.08	0.12
NJ1326002	SUEZ WATER MANALAPAN KNOB HILL	-1.41	-1.33	-1.29	-1.25	-1.22	-1.57	-1.53	-1.48	-1.44
NJ1326004	SUEZ WATER MATCHAPONIX	1.91	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1326005	SUEZ WATER MANALAPAN MILLHURST	0.21	0.21	0.21	0.21	0.21	15.94	15.98	16.03	16.07
NJ1326007	SUEZ WATER MANALAPAN TRACEY STATION	0.17	0.17	0.17	0.18	0.18	3.56	3.60	3.65	3.69
NJ1326321	MARIANNE MANOR	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1327001	MANASQUAN WATER DEPARTMENT	0.15	0.15	0.17	0.21	0.23	0.25	0.29	0.35	0.39
NJ1328002	MARLBORO TOWNSHIP WATER UTILITY DIVISION	1.36	1.51	1.74	2.04	2.24	0.28	0.32	0.38	0.41
NJ1328003	MARLBORO STATE HOSPITAL	0.28	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1329001	MATAWAN BOROUGH WATER DE	-0.02	-0.06	-0.02	0.03	0.06	-0.07	-0.03	0.03	0.07
NJ1330002	ABERDEEN - CLIFFWOOD/CLIFFWOOD BEACH	1.58	1.71	1.74	1.77	1.80	2.40	2.43	2.48	2.51
NJ1330003	ABERDEEN- HIGH SCHOOL/OAKSHADE AREA	0.08	0.10	0.11	0.11	0.12	0.86	0.89	0.94	0.97
NJ1330004	ABERDEEN - FRENEAU	-0.02	-0.03	-0.03	-0.03	-0.03	-1.72	-1.66	-1.58	-1.53
NJ1331001	GATEWAY NATIONAL REC ARE	0.02	-0.04	-0.03	-0.02	-0.02	-0.36	-0.29	-0.20	-0.14
NJ1332314	MILLSTONE MANOR	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1339001	SHORELANDS WATER CO INC	0.30	0.75	0.94	1.20	1.37	0.15	0.19	0.24	0.28
NJ1340001	RED BANK WATER DEPT	0.16	0.07	0.15	0.25	0.31	0.05	0.09	0.15	0.19
NJ1341001	ROOSEVELT WATER DEPT	0.05	0.03	0.04	0.04	0.05	0.36	0.42	0.49	0.53
NJ1344001	SEA GIRT WATER DEPT	0.15	0.13	0.14	0.16	0.17	0.51	0.55	0.61	0.65

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1345001	NJ AMERICAN WATER - COASTAL NORTH	9.25	12.83	14.69	17.21	18.89	0.27	0.31	0.36	0.40
NJ1347001	LAKE COMO WATER DEPT	-0.11	-0.13	-0.12	-0.11	-0.10	-0.68	-0.63	-0.57	-0.52
NJ1348001	SPRING LAKE WATER DEPARTMENT	0.12	0.08	0.10	0.13	0.15	0.17	0.22	0.28	0.32
NJ1349001	BOROUGH OF SPRINGLAKE HEIGHTS	0.23	0.23	0.25	0.27	0.29	0.50	0.54	0.60	0.64
NJ1350001	NJ AMERICAN WATER - UNION BEACH	-0.28	-0.35	-0.32	-0.29	-0.27	-0.64	-0.59	-0.54	-0.49
NJ1352003	WALL TWP WATER DEPT	0.41	0.26	0.37	0.52	0.62	0.11	0.15	0.22	0.26
NJ1401001	BOONTON WATER DEPT	101.65	101.65	101.65	101.65	101.65	4.02	4.02	4.02	4.02
NJ1401002	BOONTON TWP WATER DEPT	0.42	0.39	0.42	0.47	0.51	0.47	0.52	0.57	0.62
NJ1403001	BUTLER WATER DEPT	0.20	0.19	0.20	0.20	0.20	2.96	3.01	3.07	3.12
NJ1404001	CHATHAM WATER DEPT	1.83	1.80	1.87	1.94	2.00	1.36	1.41	1.46	1.51
NJ1406002	WINDY ACRES MOBILE HOME	0.30	0.27	0.31	0.36	0.40	0.29	0.34	0.39	0.43
NJ1407001	AWM FOUR SEASONS AT CHESTER	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1408001	DENVILLE TWP WATER DEPT	-0.01	-0.02	-0.01	-0.01	-0.01	-0.41	-0.36	-0.29	-0.24
NJ1409001	DOVER WATER COMMISSION	0.30	0.42	0.51	0.63	0.71	0.19	0.23	0.28	0.32
NJ1410001	EAST HANOVER TWP WATER DEPT	0.08	0.56	0.68	0.82	0.92	0.19	0.22	0.27	0.30
NJ1411001	FLORHAM PARK WATER DEPT	0.17	-0.25	-0.14	-0.01	0.08	-0.13	-0.07	-0.01	0.04
NJ1413001	LAKESHORE COMPANY	-0.22	-0.13	-0.07	0.00	0.06	-0.09	-0.05	0.00	0.04
NJ1414003	JEFFERSON TWP W U MILTON SYSTEM	0.05	0.05	0.05	0.05	0.05	1.15	1.20	1.25	1.30
NJ1414006	LOZIERS TRAILER PARK	0.13	0.15	0.16	0.17	0.19	0.57	0.61	0.66	0.70
NJ1414008	OAK RIDGE MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1414011	JEFFERSON TWP WATER UTILITY LAKE HOPATCONG	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1414013	SUN VALLEY PARK	0.34	0.22	0.26	0.30	0.33	0.34	0.40	0.46	0.51
NJ1414014	SANDY POINT MOBILE HOME	0.07	0.07	0.07	0.07	0.07	3.05	3.05	3.05	3.05
NJ1414016	JEFFERSON TWP W U VASSAR ROAD	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1415001	FAYSON LAKES WATER COMPANY INC	0.00	0.00	0.00	0.01	0.01	0.63	0.66	0.71	0.74
NJ1415002	KINNELON WATER DEPT	0.01	-0.03	-0.02	0.00	0.01	-0.12	-0.07	-0.01	0.04
NJ1416001	BOROUGH OF LINCOLN PARK WATER DEPT	0.46	0.46	0.47	0.48	0.48	2.37	2.41	2.47	2.51
NJ1416004	BOROUGH OF LINCOLN PARK JACKSONVILLE SYST	0.14	0.12	0.18	0.26	0.32	0.08	0.13	0.18	0.23
NJ1417001	MADISON WATER DEPT	-0.06	-0.06	-0.06	-0.05	-0.05	-0.97	-0.93	-0.88	-0.84
NJ1418002	SISTERS OF CHRISTIAN CHARITY	0.30	0.20	0.30	0.42	0.51	0.09	0.14	0.20	0.24
NJ1419001	ROXITICUS WATER COMPANY INC.	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1420001	MINE HILL TWP WATER DEPT	0.22	0.24	0.25	0.26	0.27	1.07	1.12	1.17	1.20
NJ1421003	MONTVILLE TWP MUA	0.44	0.60	0.70	0.83	0.93	0.24	0.28	0.33	0.37
NJ1421305	ST ALBERTS RESIDENTIAL HEALTH CENTER	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1422001	SISTERS OF CHARITY OF SE	0.03	0.03	0.03	0.04	0.04	0.61	0.66	0.71	0.74
NJ1424001	SOUTHEAST MORRIS COUNTY MUA	4.24	5.41	5.79	6.22	6.56	0.58	0.63	0.67	0.71
NJ1425001	MOUNTAIN LAKES WATER DEP	0.05	0.02	0.05	0.08	0.11	0.04	0.09	0.14	0.19
NJ1426002	MOUNT ARLINGTON DPW KADEL SYS	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1426004	SUEZ WATER NEW JERSEY ARLINGTON HILLS	0.07	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1426005	MOUNT ARLINGTON BORO DPW MAIN	0.02	0.04	0.05	0.06	0.07	0.15	0.19	0.24	0.28
NJ1427001	MT OLIVE VILLAGES WATER	0.12	0.21	0.22	0.23	0.23	0.81	0.84	0.88	0.90
NJ1427002	MOUNT OLIVE TWP - GOLDMINE SYSTEM	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1427005	MOUNT OLIVE TWP - FLANDERS	0.07	0.02	0.06	0.10	0.13	0.03	0.08	0.14	0.18
NJ1427006	MOUNT OLIVE TWP - SAND	0.06	0.05	0.05	0.05	0.06	0.77	0.82	0.89	0.94
NJ1427007	MOUNT OLIVE TWP - VILLAGE	0.04	0.07	0.08	0.08	0.09	0.48	0.51	0.56	0.59
NJ1427008	MOUNT OLIVE TWP - PINECREST	0.02	0.01	0.01	0.02	0.02	0.21	0.26	0.33	0.38
NJ1427009	NJ AMERICAN WATER - MOUNT OLIVE - WEST JERSEY	0.04	0.03	0.03	0.03	0.04	0.60	0.65	0.71	0.76
NJ1427010	NJ VASA HOME WATER SYS	0.03	0.02	0.03	0.03	0.03	1.94	2.01	2.08	2.14

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1427012	MOUNT OLIVE TWP - LYNWOOD	0.01	0.01	0.01	0.01	0.01	3.44	3.49	3.54	3.59
NJ1427014	MOUNT OLIVE TWP - CARLTON HILLS	0.01	0.01	0.01	0.02	0.02	0.30	0.35	0.40	0.44
NJ1427015	MOUNT OLIVE TWP - TINC FARM	0.03	0.02	0.03	0.03	0.03	0.43	0.48	0.55	0.60
NJ1427016	AWM COUNTRY OAKS	0.02	0.02	0.02	0.02	0.02	0.58	0.58	0.58	0.58
NJ1427017	NJ AMERICAN WATER - ITC	0.30	0.29	0.29	0.30	0.31	1.63	1.68	1.74	1.78
NJ1427018	MORRIS CHASE/MORRIS HUNT PCWS	0.04	0.04	0.04	0.05	0.05	0.41	0.46	0.52	0.56
NJ1428001	NETCONG WATER DEPT	0.17	0.17	0.19	0.20	0.21	0.58	0.62	0.68	0.72
NJ1429001	PARSIPPANY-TROY HILLS WATER DEPARTMENT	1.49	1.89	2.18	2.51	2.77	0.29	0.33	0.38	0.42
NJ1431001	PEQUANNOCK TWP WATER DEPARTMENT	0.95	0.64	0.73	0.84	0.92	0.40	0.45	0.52	0.57
NJ1431002	PEQUANNOCK TWP WD-CEDAR CREST	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1432001	MORRIS COUNTY MUA	1.87	1.87	2.08	2.32	2.51	0.41	0.46	0.51	0.55
NJ1432003	RANDOLPH TWP PUBLIC WORKS DEPT	0.41	0.29	0.37	0.47	0.54	0.18	0.22	0.28	0.33
NJ1433001	RIVERDALE BORO WATER DEP	0.13	0.09	0.12	0.15	0.18	0.15	0.19	0.25	0.30
NJ1434001	ROCKAWAY BORO WATER DEPT	0.26	0.27	0.32	0.37	0.41	0.28	0.32	0.38	0.42
NJ1435001	HOFFMAN HOMES COMMUNITY LLC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1435002	ROCKAWAY TWP WATER DEPT	0.12	-0.16	-0.08	0.02	0.10	-0.11	-0.05	0.01	0.06
NJ1435003	AWO&M - PICATINNY ARSENAL	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1436002	ROXBURY WATER CO	0.29	0.13	0.18	0.24	0.29	0.14	0.19	0.26	0.30
NJ1436003	ROXBURY TWP W DEPT-SHORE	0.26	0.25	0.26	0.28	0.30	0.74	0.79	0.84	0.89
NJ1436004	ROXBURY TWP W DEPT-SKY V	0.16	0.17	0.19	0.21	0.23	0.42	0.46	0.52	0.56
NJ1438001	AQUA NJ CLIFFSIDE PARK	0.05	0.05	0.05	0.05	0.05	9.06	9.11	9.17	9.21
NJ1438003	WASHINGTON TWP MUA-HAGER	0.04	0.04	0.04	0.04	0.04	7.69	7.73	7.78	7.82
NJ1438004	WASHINGTON TWP MUA-SCHOOLEYS MOUNTAIN	0.05	0.04	0.06	0.07	0.09	0.13	0.18	0.23	0.27

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1438006	SHERWOOD VILLAGE	0.02	0.08	0.10	0.13	0.15	0.14	0.18	0.23	0.27
NJ1439001	WHARTON WATER DEPT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1501001	BARNEGAT LIGHT WATER DEP	-0.27	-0.19	-0.12	-0.04	0.02	-0.12	-0.08	-0.03	0.01
NJ1503001	BEACH HAVEN WATER DEPT	-0.20	-0.25	-0.23	-0.20	-0.18	-0.56	-0.51	-0.45	-0.40
NJ1504001	BEACHWOOD WATER DEPT	0.31	0.22	0.24	0.27	0.29	0.52	0.58	0.65	0.69
NJ1505002	AQUA NJ - EASTERN DIVISION	0.09	0.04	0.08	0.13	0.17	0.04	0.09	0.15	0.19
NJ1505003	SHORE WATER COMPANY	0.38	0.44	0.47	0.52	0.55	0.52	0.56	0.62	0.65
NJ1505004	BERKELEY TWP MUA	0.08	-0.20	-0.18	-0.16	-0.14	-1.13	-1.02	-0.87	-0.77
NJ1506001	BRICK TOWNSHIP MUA	0.84	0.86	0.89	0.94	0.96	1.17	1.22	1.27	1.31
NJ1507005	SUEZ WATER TOMS RIVER INC	7.39	5.98	6.41	6.99	7.37	0.69	0.74	0.81	0.85
NJ1507007	NJ AMERICAN WATER - ORTLEY BEACH	7.13	5.30	5.84	6.57	7.05	0.49	0.54	0.61	0.65
NJ1507008	NJ AMERICAN WATER - PELICAN ISLAND	0.06	0.06	0.06	0.06	0.06	4.02	4.06	4.12	4.16
NJ1508001	EAGLESWOOD VILLAGE MHP	-0.16	-0.15	-0.13	-0.11	-0.09	-0.37	-0.33	-0.27	-0.24
NJ1509001	HARVEY CEDARS WATER DEPT	0.07	0.03	0.04	0.05	0.06	0.15	0.20	0.27	0.32
NJ1510001	ISLAND HEIGHTS WATER DEP	2.43	1.02	1.21	1.47	1.64	0.33	0.39	0.47	0.53
NJ1511001	JACKSON TWP MUA	0.04	0.01	0.01	0.02	0.02	0.33	0.40	0.50	0.57
NJ1511002	JACKSON ACRES MHP	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1511003	LAND O PINES MOBILE HOME PARK	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1511004	MAPLE GLEN MOBILE HOME PARK	0.07	0.06	0.07	0.07	0.07	2.97	3.02	3.09	3.14
NJ1511005	OAK TREE MOBILE HOME PARK	-0.16	-0.44	-0.42	-0.38	-0.35	-1.11	-1.04	-0.94	-0.88
NJ1511007	SILVER PINE PARK LAND LLC	0.01	0.00	0.01	0.01	0.01	0.05	0.10	0.17	0.21
NJ1511008	SOUTH WIND MOBILE HOME V	0.05	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1511010	USDOD JOINT BASE MCGUIRE DIX LAKEHURST	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1511011	ALL SEASONS MHP	0.09	0.08	0.08	0.08	0.09	7.41	7.46	7.53	7.57

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1511013	FOUNTAINHEAD PARKS INC	0.09	0.09	0.09	0.09	0.09	11.08	11.13	11.20	11.24
NJ1511016	MEADOWBROOK CO-OP INC	0.37	0.37	0.37	0.37	0.37	1.06	1.06	1.06	1.06
NJ1512001	LACEY TWP MUA	0.51	0.28	0.38	0.51	0.59	0.14	0.19	0.25	0.29
NJ1513001	LAKEHURST WATER DEPT	0.13	0.11	0.12	0.14	0.15	0.45	0.49	0.56	0.60
NJ1514002	LAKEWOOD TWP MUA	0.36	-0.43	-0.22	0.07	0.26	-0.10	-0.05	0.02	0.06
NJ1515001	LAVALLETTE WATER DEPT	0.14	0.10	0.12	0.14	0.15	0.30	0.34	0.41	0.45
NJ1516001	LITTLE EGG HARBOR TWP MU	0.96	0.43	0.51	0.62	0.70	0.30	0.36	0.44	0.49
NJ1517001	LONG BEACH TWP BRANT BEACH	0.17	0.20	0.24	0.30	0.33	0.22	0.26	0.31	0.35
NJ1517002	LONG BEACH TWP WATER DEPT HOLGATE	0.02	-0.04	-0.03	-0.01	0.00	-0.16	-0.11	-0.04	0.01
NJ1517003	LONG BEACH TWP NORTH BEACH	-0.24	-0.25	-0.24	-0.24	-0.23	-2.26	-2.21	-2.15	-2.11
NJ1517004	LONG BEACH TWP LOVE LADIES SOUTH	-0.42	-0.62	-0.61	-0.58	-0.57	-3.16	-3.08	-2.96	-2.88
NJ1517005	LONG BEACH TWP LOVE LADIES NORTH	-0.33	-0.49	-0.48	-0.46	-0.45	-3.13	-3.04	-2.92	-2.85
NJ1517006	LONG BEACH TWP HIGH BAR HARBOR	-0.28	-0.25	-0.25	-0.24	-0.24	-2.91	-2.88	-2.84	-2.82
NJ1518001	CEDAR GLEN HOMES INC	0.05	0.03	0.04	0.04	0.04	0.84	0.90	0.98	1.04
NJ1518002	CEDAR GLEN LAKES WATER C	0.04	0.02	0.03	0.04	0.05	0.16	0.21	0.27	0.32
NJ1518003	CEDAR GLEN WEST WATER CO	0.00	-0.02	-0.02	-0.01	0.00	-0.22	-0.17	-0.10	-0.05
NJ1518004	MANCHESTER TWP WATER - WESTERN	0.85	0.38	0.46	0.56	0.63	0.28	0.33	0.41	0.46
NJ1518005	MANCHESTER TWP WATER UTILITY - EASTERN	-0.37	-0.86	-0.74	-0.58	-0.47	-0.37	-0.32	-0.25	-0.20
NJ1518010	MANCHESTER VILLAGE	0.09	0.09	0.09	0.09	0.09	10.85	10.88	10.93	10.96
NJ1518011	MANCHESTER TWP WATER UTILITY LACEY ROAD	0.00	N/A	N/A	N/A	N/A	0.00	0.00	0.00	0.00
NJ1518345	ARISTACARE AT MANCHESTER	0.38	-0.07	-0.01	0.08	0.14	-0.07	-0.01	0.08	0.13
NJ1520001	OCEAN TWP DEPT OF UTILITIES	0.02	-0.04	-0.02	-0.01	0.01	-0.14	-0.09	-0.02	0.02
NJ1521001	OCEAN GATE WATER DEPT	0.01	0.00	0.01	0.02	0.03	-0.02	0.03	0.09	0.13
NJ1522001	PINE BEACH WATER DEPT	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1523001	COLLIER MILLS MOBILE EST	0.03	0.02	0.02	0.02	0.03	0.62	0.68	0.77	0.82
NJ1523002	DEEP RUN ADULT VILLAGE	0.02	-0.02	-0.02	0.00	0.00	-0.16	-0.10	-0.02	0.03
NJ1523003	NJ AMERICAN WATER - NEW EGYPT	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NJ1523004	OAK GROVE MHP	1.10	0.73	0.81	0.93	1.01	0.44	0.49	0.56	0.61
NJ1524001	POINT PLEASANT WATER DEPARTMENT	0.47	0.31	0.35	0.40	0.43	0.40	0.45	0.52	0.57
NJ1525001	POINT PLEASANT BEACH WATER DEPARTMENT	0.36	0.19	0.22	0.26	0.28	0.38	0.43	0.51	0.56
NJ1526001	SEASIDE HEIGHTS WATER DE	0.15	0.17	0.19	0.21	0.23	0.38	0.42	0.47	0.51
NJ1527001	SEASIDE PARK WATER DEPT	0.03	0.23	0.24	0.25	0.26	0.51	0.54	0.57	0.59
NJ1528001	SHIP BOTTOM WATER DEPART	-0.02	-0.02	-0.02	-0.02	-0.02	-3.18	-3.13	-3.06	-3.01
NJ1530003	STAFFORD TWP MUA CEDAR B	1.48	0.98	1.09	1.24	1.34	0.46	0.51	0.58	0.63
NJ1530004	STAFFORD TWP WATER - BEACH HAVEN WEST	0.14	0.09	0.10	0.11	0.11	0.74	0.80	0.88	0.94
NJ1530005	STAFFORD TWP MUA FAWN LA	0.42	0.37	0.39	0.42	0.44	0.85	0.90	0.96	1.00
NJ1530007	CEDAR RUN SENIOR CIT APT	0.18	0.13	0.14	0.16	0.18	0.40	0.45	0.52	0.57
NJ1531001	SURF CITY WATER DEPT	0.74	0.64	0.72	0.84	0.92	0.33	0.37	0.43	0.47
NJ1532002	TUCKERTON WATER & SEWER DEPT	0.04	-0.04	-0.04	-0.03	-0.02	-0.48	-0.39	-0.28	-0.21
NJ1533001	BARNEGAT TWP WATER & SEWER UTILITIES	0.05	-0.02	0.01	0.04	0.07	-0.04	0.02	0.08	0.12
NJ1533002	PINEWOOD ESTATES-BRIGHTN	0.21	0.11	0.17	0.24	0.30	0.08	0.13	0.19	0.24
NJ1601001	BLOOMINGDALE WATER DEPT	1.47	1.52	1.63	1.75	1.85	0.64	0.68	0.74	0.78
NJ1603001	MANCHESTER UTILITIES AUTHORITY	0.43	0.03	0.13	0.24	0.33	0.02	0.07	0.14	0.19
NJ1604001	HAWTHORNE WATER DEPARTMENT	5.37	-4.62	-0.14	3.98	8.07	-0.05	0.00	0.05	0.09
NJ1605001	NJ AMERICAN WATER - LITTLE FALLS	0.06	0.07	0.07	0.07	0.07	4.55	4.55	4.55	4.55
NJ1605002	PASSAIC VALLEY WATER COMMISSION	0.25	-0.05	0.01	0.09	0.14	-0.05	0.01	0.08	0.14
NJ1606301	HOLLAND CHRISTIAN HOME	0.17	-0.06	-0.02	0.03	0.07	-0.09	-0.03	0.04	0.10
NJ1609001	POMPTON LAKES MUA	0.18	-0.06	0.04	0.16	0.25	-0.03	0.02	0.08	0.13

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1611002	RINGWOOD WATER DEPARTMENT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1612001	TOTOWA W DEPT	29.71	29.71	34.87	40.93	45.58	0.26	0.31	0.36	0.41
NJ1612301	LITTLE SISTERS OF THE POOR	0.99	0.84	0.89	0.95	0.99	0.88	0.93	1.00	1.05
NJ1613002	WANAQUE WATER DEPARTMENT	1.21	-0.28	0.13	0.61	0.98	-0.04	0.02	0.08	0.13
NJ1614001	WAYNE TOWNSHIP DIVISION OF WATER	-0.01	-0.01	-0.01	-0.01	-0.01	-0.80	-0.73	-0.66	-0.61
NJ1615001	WEST MILFORD TWP MUA - BIRCH HILL PARK	-0.01	-0.03	-0.03	-0.02	-0.02	-0.70	-0.64	-0.56	-0.49
NJ1615002	WEST MILFORD TWP MUA GREENBROOK ESTATES	-0.14	-0.17	-0.17	-0.16	-0.16	-1.73	-1.67	-1.60	-1.54
NJ1615003	PASSAIC VALLEY W C HIGH CREST	0.00	0.00	0.00	0.00	0.00	-0.37	-0.31	-0.24	-0.18
NJ1615006	WEST MILFORD TWP MUA PARKWAY	0.02	0.02	0.02	0.02	0.02	0.59	0.64	0.70	0.75
NJ1615008	PVWC-POSTBROOK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1615009	REFLECTION LAKES GARDEN APARTMENTS	-0.01	-0.06	-0.05	-0.05	-0.04	-1.07	-0.98	-0.88	-0.80
NJ1615012	WEST MILFORD TWP MUA AWOSTING	-0.05	-0.06	-0.06	-0.05	-0.05	-1.10	-1.05	-0.97	-0.92
NJ1615014	WEST MILFORD TWP MUA CRESCENT PARK	0.04	0.02	0.02	0.03	0.03	0.16	0.21	0.28	0.33
NJ1615016	WEST MILFORD TWP MUA OLDE MILFORD ESTATES	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1615017	WONDER LAKE PROPERTIES I	-0.02	-0.07	-0.06	-0.05	-0.05	-1.04	-0.96	-0.86	-0.79
NJ1615018	WEST MILFORD TWP BALD EAGLE VILLAGE	0.03	0.02	0.02	0.02	0.03	0.35	0.41	0.48	0.53
NJ1615020	SUEZ WATER NEW JERSEY WEST MILFORD	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1615022	WOODLAND HEIGHTS HOMEOWNER ASSOC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1615340	MILFORD MANOR	0.13	0.19	0.23	0.29	0.33	0.18	0.22	0.27	0.31
NJ1616001	WOODLAND PARK WATER DEPARTMENT	0.10	0.11	0.11	0.12	0.12	0.89	0.93	0.98	1.01
NJ1702001	ELMER BORO W DEPT	0.10	0.10	0.10	0.10	0.10	29.72	29.76	29.80	29.84
NJ1704001	LEISURE ARMS COMPLEX	0.08	0.08	0.09	0.09	0.09	8.19	8.23	8.27	8.30
NJ1706001	AUBURN VILLAGE WATER SUP	1.02	1.26	1.29	1.35	1.38	1.10	1.14	1.18	1.21

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1707001	NJ AMERICAN WATER - PENNS GROVE	0.20	0.42	0.46	0.52	0.55	0.36	0.40	0.44	0.47
NJ1708001	PENNSVILLE TWSP. WATER DEPARTMENT	0.02	0.01	0.02	0.02	0.03	0.18	0.23	0.29	0.34
NJ1710001	HARDING WOODS MHP	0.05	0.05	0.05	0.05	0.05	1.36	1.40	1.46	1.50
NJ1710002	HOLLY TREE ACRES SYSTEM 1	-0.08	-0.09	-0.09	-0.08	-0.08	-1.02	-0.98	-0.91	-0.87
NJ1710003	PICNIC GROVE MHC, LLC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1710006	VILLAGE I	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1710304	EAGLEVIEW HEALTH AND REHABILITATION	1.57	1.73	1.77	1.81	1.84	1.93	1.96	2.01	2.04
NJ1712001	SALEM WATER DEPARTMENT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1713001	HANDYS MOBILE PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1714001	COUNTRY CLUB ESTATES	0.07	0.07	0.07	0.07	0.07	4.40	4.44	4.50	4.53
NJ1714003	BANCROFT NEURO HEALTH CENTER	0.10	0.18	0.19	0.21	0.22	0.47	0.51	0.55	0.58
NJ1715001	WOODSTOWN WATER DEPARTMENT	0.06	0.06	0.06	0.07	0.07	3.85	3.89	3.94	3.98
NJ1803002	NJ AMERICAN WATER - TWIN LAKES	1.04	0.33	0.59	0.90	1.14	0.06	0.12	0.18	0.23
NJ1808001	FRANKLIN TOWNSHIP DEPT OF PUBLIC WORKS	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1815300	MATHENY MEDICAL AND EDUCATION CENTER	0.01	0.00	0.01	0.01	0.02	0.05	0.10	0.16	0.20
NJ1817001	ROCKY HILL W DEPT	-0.02	-0.02	-0.02	-0.01	0.00	-0.18	-0.13	-0.08	-0.03
NJ1901001	ANDOVER BORO WATER DEPT	0.03	0.01	0.01	0.02	0.02	0.12	0.18	0.25	0.30
NJ1902003	LAKE LENAPE WATER CO	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1902004	ANDOVER WATER CORP	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1902005	ASCOT PARK APTS	0.06	0.05	0.06	0.06	0.06	1.54	1.59	1.65	1.70
NJ1902007	ROLLING HILLS CONDOMINIUM ASSOCIATION	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1902008	ANDOVER NURSING HOME	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1902009	ANDOVER INTERMEDIATE CARE CNTR	0.07	0.07	0.07	0.07	0.07	4.51	4.51	4.51	4.51
NJ1902346	WILLOW GLEN ACADEMY/ABBEY	0.08	0.07	0.08	0.08	0.08	0.84	0.89	0.94	0.99

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1903001	BRANCHVILLE W DEPT	0.04	0.04	0.04	0.05	0.05	0.40	0.44	0.50	0.54
NJ1904001	BROOKWOOD MUSCONETCONG RIVER POA	-0.01	0.00	0.00	0.00	0.00	-0.08	-0.04	0.01	0.05
NJ1904002	EAST BROOKWOOD ESTATES POA	0.04	0.00	0.01	0.02	0.02	0.04	0.10	0.17	0.23
NJ1904003	FOREST LAKES WATER COMPANY	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1904004	NORTH SHORE WATER ASSOCIATION	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1904006	STRAWBERRY POINT PROP OW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1904007	COLBY WATER CO	0.02	0.02	0.03	0.03	0.03	0.74	0.78	0.82	0.85
NJ1904009	AQUA NJ - BYRAM	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1905002	CULVER LAKE WATER COMPANY	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	0.02	0.00	0.01	0.01	0.01	0.09	0.15	0.22	0.28
NJ1906001	HILLSIDE ESTATES AT FRANKLIN	0.13	0.14	0.16	0.18	0.19	0.38	0.43	0.48	0.52
NJ1906002	FRANKLIN BOARD OF PUBLIC WORKS	0.09	0.09	0.09	0.09	0.09	9.97	10.02	10.08	10.13
NJ1907001	GREEN HILLS EST PROP OWN	0.05	0.05	0.05	0.05	0.05	2.02	2.07	2.13	2.18
NJ1907002	AQUA NJ - BEAR BROOK	0.07	0.07	0.08	0.08	0.08	3.16	3.20	3.25	3.29
NJ1908001	AQUA NJ - TRANQUILITY SPRINGS	0.16	0.17	0.18	0.20	0.21	0.61	0.66	0.71	0.75
NJ1909001	HAMBURG BOARD OF PUBLIC WORKS	0.08	0.07	0.07	0.07	0.07	4.49	4.55	4.62	4.68
NJ1910002	CARRIAGE MOBILE HOMES INC	0.06	0.05	0.05	0.06	0.06	1.51	1.58	1.65	1.70
NJ1910003	SUEZ WATER NEW JERSEY HAMPTON	-0.01	-0.03	-0.02	-0.01	-0.01	-0.20	-0.15	-0.09	-0.04
NJ1911001	AQUA NJ WALLKILL	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1911002	LAKE STOCKHOLM INC	0.02	0.01	0.02	0.02	0.02	0.45	0.50	0.56	0.61
NJ1911003	LAKE TAMARACK W CO	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1911004	AQUA NJ - SUMMIT LAKE	0.05	0.04	0.04	0.04	0.05	0.55	0.60	0.66	0.71
NJ1911005	HARDYSTON TWP MUA	0.32	0.26	0.27	0.29	0.30	1.42	1.48	1.55	1.60
NJ1911006	HARDYSTON TWP MUA	0.11	0.14	0.16	0.18	0.19	0.35	0.39	0.44	0.48

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ1912001	HOPATCONG WATER DEPT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1912300	LOCOR LAKEFRONT LODGING	0.13	0.11	0.11	0.12	0.12	1.24	1.30	1.37	1.43
NJ1914002	MONTAGUE WATER CO.	0.25	0.26	0.30	0.34	0.37	0.33	0.37	0.42	0.47
NJ1915001	NEWTON WATER & SEWER UTILITY	0.10	0.09	0.10	0.11	0.12	0.49	0.54	0.60	0.64
NJ1916001	OGDENSBURG W DEPT	0.06	0.10	0.10	0.11	0.11	0.75	0.79	0.82	0.85
NJ1918003	SPARTA TWP WATER UTILITY -- HIGHLANDS	0.36	0.24	0.32	0.41	0.47	0.16	0.21	0.27	0.31
NJ1918004	SPARTA TWP WATER UTILITY - LAKE MOHAWK	0.02	0.03	0.03	0.03	0.03	1.21	1.25	1.30	1.34
NJ1918013	SPARTA TWP WATER UTILITY - SUNSET	0.34	0.34	0.35	0.37	0.38	1.09	1.14	1.20	1.24
NJ1919001	STANHOPE W DEPT	0.04	0.06	0.06	0.07	0.07	0.43	0.47	0.52	0.56
NJ1920001	STILLWATER WATER DISTRICT 1	0.42	0.39	0.40	0.41	0.42	1.93	1.99	2.05	2.09
NJ1921001	SUSSEX WATER DEPT	0.00	0.00	0.00	0.00	0.00	-0.28	-0.23	-0.18	-0.14
NJ1922001	SUEZ WATER NEW JERSEY BARRY LAKES	0.01	0.01	0.01	0.01	0.01	3.70	3.76	3.83	3.88
NJ1922004	SUEZ WATER NEW JERSEY WOODRIDGE ESTATES	-0.02	-0.02	-0.02	-0.02	-0.02	-2.87	-2.83	-2.77	-2.73
NJ1922005	SUEZ WATER NEW JERSEY GRANDVIEW ESTATES	0.01	0.01	0.01	0.01	0.01	0.91	0.94	0.97	1.00
NJ1922006	SUEZ WATER NEW JERSEY SUSSEX HILLS	0.03	0.03	0.03	0.03	0.03	0.54	0.59	0.64	0.69
NJ1922008	AQUA NJ - VERNON	0.02	0.03	0.03	0.03	0.03	1.92	1.95	1.98	2.01
NJ1922010	VILLAGE OF LAKE GLENWOOD	0.03	0.03	0.03	0.03	0.03	2.26	2.31	2.36	2.40
NJ1922011	SUEZ WATER NEW JERSEY SUNSET RIDGE	-0.03	-0.03	-0.03	-0.03	-0.03	-2.78	-2.74	-2.68	-2.64
NJ1922012	SUEZ WATER NEW JERSEY LAKE CONWAY	-0.02	-0.02	-0.02	-0.02	-0.02	-3.38	-3.34	-3.28	-3.24
NJ1922013	SUEZ WATER NEW JERSEY DAVID CURTIS	0.00	0.00	0.00	0.00	0.00	-0.20	-0.16	-0.11	-0.07
NJ1922015	SUEZ WATER NEW JERSEY WALNUT HILLS	0.01	0.01	0.01	0.01	0.01	2.72	2.78	2.85	2.90
NJ1922017	SUEZ WATER NEW JERSEY HIGHLAND LAKES	0.00	0.00	0.00	0.00	0.00	-0.43	-0.40	-0.36	-0.34
NJ1922021	SUEZ WATER NEW JERSEY PREDMORE	-0.01	-0.01	-0.01	-0.01	-0.01	-0.92	-0.89	-0.85	-0.82

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
	ESTATES									
NJ1922022	SUEZ WATER NEW JERSEY SAMMIS ROAD	0.03	-0.01	0.01	0.04	0.06	-0.03	0.02	0.08	0.13
NJ1922026	SUEZ WATER NEW JERSEY VERNON VALLEY	0.03	0.03	0.03	0.03	0.04	3.13	3.18	3.24	3.28
NJ1922027	HIDDEN VILLAGE CONDO ASSOCIATION	0.09	0.09	0.09	0.09	0.09	8.72	8.77	8.82	8.86
NJ1924002	SIMMONS W CO	0.06	0.06	0.06	0.07	0.07	4.20	4.24	4.30	4.34
NJ1924003	REGENCY APARTMENTS LLC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1924004	SUEZ WATER NEW JERSEY WOODBRIDGE ESTATES	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ1924006	TOWN CENTER AT WANTAGE	7.54	5.23	6.01	6.94	7.64	0.35	0.41	0.47	0.52
NJ2004001	LIBERTY WATER CO C/O NJ AMERICAN WATER	34.82	62.44	67.62	71.46	76.22	0.45	0.48	0.51	0.54
NJ2004002	NJ AMERICAN WATER - RARITAN	1.32	0.70	0.95	1.24	1.47	0.15	0.20	0.26	0.31
NJ2013001	RAHWAY CITY WATER DEPT	0.22	0.17	0.18	0.19	0.20	1.32	1.38	1.45	1.51
NJ2021001	WINFIELD MUTUAL HOUSING	-0.06	0.02	0.03	0.05	0.07	0.04	0.07	0.12	0.15
NJ2101001	ALLAMUCHY TWP WATER & SEWER	0.15	0.14	0.15	0.16	0.17	0.63	0.68	0.73	0.78
NJ2102001	ALPHA MUNICIPAL WATER WORKS	0.28	0.24	0.26	0.28	0.29	0.75	0.80	0.86	0.91
NJ2103001	NJ AMERICAN WATER - BELVIDERE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2103002	BELVIDERE SQUARE APT COMPLEX	-0.03	-0.03	-0.03	-0.03	-0.02	-0.49	-0.44	-0.39	-0.35
NJ2104001	BLAIRSTOWN WATER DEPARTM	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2106304	FOREST MANOR RETIREMENT HOME	0.84	0.69	0.81	0.94	1.04	0.30	0.35	0.40	0.45
NJ2108001	HACKETTSTOWN MUA	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2110001	AQUA NJ - BRAINARDS	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2110003	AQUA NJ - HARKERS HOLLOW	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2112001	INDEPENDENCE MUA VALLEY VIEW	-0.01	0.00	0.00	0.00	0.00	-0.16	-0.11	-0.06	-0.02
NJ2112002	INDEPENDENCE MUA HIGHLND	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2113002	RIVERSIDE MOBILE HOME PA	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ2113003	TRIPLE BROOK MOBILE HOME	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2113301	CLOVER REST HOME	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2116002	HILLSIDE VILLAGE	0.02	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2116003	NJ AMERICAN WATER - MANSFIELD	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2116004	WARREN HAVEN NURSING H	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2116328	CAMP HOPE	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2117002	VALLEY VIEW ESTATES	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2117003	OXFORD MANOR LLC	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2119001	AQUA NJ INC - PHILLIPSBURG	0.92	0.96	1.12	1.30	1.45	0.27	0.32	0.37	0.41
NJ2120001	AQUA NJ INC - RIEGELSVILLE	0.92	0.96	1.12	1.30	1.45	0.27	0.32	0.37	0.41
NJ2120002	AQUA NJ - WARREN GLEN	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2121001	NJ AMERICAN WATER - WASHINGTON/OXFORD	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ2123002	WINDTRYST APTS	0.09	0.09	0.09	0.09	0.09	8.41	8.46	8.52	8.56
NJ2123003	COUNTRY VIEW VILLAGE, LLC	0.09	0.09	0.09	0.09	0.09	8.41	8.46	8.52	8.56
NJ1025308	PATTENBURG HOUSE	0.49	0.53	0.59	0.65	0.69	0.44	0.49	0.54	0.58
NJ1710007	HOLLY TREE ACRES SYSTEM 2	0.49	0.53	0.59	0.65	0.69	0.44	0.49	0.54	0.58
NJ1436006	ROXBURY TWP WD - EVERGREEN	0.02	0.02	0.02	0.02	0.02	1.47	1.51	1.56	1.59
NJ1427003	MT. OLIVE TWP - INDIAN SPRINGS	0.02	0.02	0.02	0.02	0.02	1.47	1.51	1.56	1.59
NJ1714300	MATER DEI NURSING HOME	0.08	0.05	0.06	0.06	0.06	2.64	2.74	2.85	2.93
NJ1208001	NJ AMERICAN - JAMESBURG	0.08	0.05	0.06	0.06	0.06	2.64	2.74	2.85	2.93

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0102001	ATLANTIC CITY MUA	12.56	12.61	13.06	13.67	14.08	1.18	1.22	1.28	1.32
NJ0103001	BRIGANTINE WATER DEPARTMENT	0.55	0.17	0.26	0.39	0.47	0.10	0.15	0.22	0.26
NJ0104003	BUENA BOROUGH MUA	0.12	0.08	0.11	0.14	0.16	0.16	0.20	0.26	0.30
NJ0105001	BUENA FAMILY MANOR MOBILE H P	0.09	0.09	0.09	0.09	0.09	13.95	14.00	14.06	14.10
NJ0105002	GARDEN HOMES MANAGEMENT CORPORATION	0.07	0.07	0.07	0.07	0.07	3.99	4.04	4.09	4.13
NJ0107001	EGG HARBOR CITY WATER DEPT	0.19	0.18	0.20	0.22	0.23	0.56	0.60	0.66	0.70
NJ0108002	ENGLISH CREEK MANOR M H PARK	0.07	0.07	0.07	0.07	0.08	3.84	3.88	3.93	3.96
NJ0108003	TILTON TERRACE MH	0.00	0.00	0.00	0.00	0.00	-0.10	-0.05	0.00	0.04
NJ0108004	NORMS DALE MOBILE HOME PARK	0.06	0.06	0.06	0.06	0.06	2.80	2.84	2.89	2.92
NJ0108005	AQUA NJ - SEAVIEW HARBOR	0.06	0.03	0.04	0.04	0.04	1.55	1.63	1.75	1.83
NJ0108006	TOWER MOBILE HOMES	0.08	0.08	0.08	0.08	0.08	6.56	6.60	6.65	6.69
NJ0108009	STONE FIELD MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108013	TOWER 1999 MOBILE HOME PARK	0.07	0.07	0.07	0.07	0.07	2.65	2.68	2.73	2.77
NJ0108014	TOWER EAST MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108019	OAK FOREST MOBILE HOME PARK	0.04	0.04	0.04	0.04	0.05	1.34	1.38	1.43	1.46
NJ0108023	EGG HARBOR RIVER RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108303	BAY BREEZE VILLAGE	0.10	0.10	0.10	0.10	0.10	112.72	112.79	112.89	112.96
NJ0111004	POMONA MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111006	SHADY PINES CAMPING RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111007	SWAN LAKE RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0112001	HAMILTON TOWNSHIP MUA	1.16	1.21	1.29	1.40	1.48	0.60	0.64	0.70	0.74
NJ0112002	BLACK HORSE MANOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0113001	HAMMONTON WATER DEPT	0.47	0.35	0.41	0.49	0.55	0.27	0.32	0.38	0.42
NJ0115001	LONGPORT WATER DEPARTMENT	-0.02	-0.03	-0.02	0.01	0.03	-0.08	-0.04	0.02	0.06

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0102001	ATLANTIC CITY MUA	12.56	12.61	13.06	13.67	14.08	1.18	1.22	1.28	1.32
NJ0103001	BRIGANTINE WATER DEPARTMENT	0.55	0.17	0.26	0.39	0.47	0.10	0.15	0.22	0.26
NJ0104003	BUENA BOROUGH MUA	0.12	0.08	0.11	0.14	0.16	0.16	0.20	0.26	0.30
NJ0105001	BUENA FAMILY MANOR MOBILE H P	0.09	0.09	0.09	0.09	0.09	13.95	14.00	14.06	14.10
NJ0105002	GARDEN HOMES MANAGEMENT CORPORATION	0.07	0.07	0.07	0.07	0.07	3.99	4.04	4.09	4.13
NJ0107001	EGG HARBOR CITY WATER DEPT	0.19	0.18	0.20	0.22	0.23	0.56	0.60	0.66	0.70
NJ0108002	ENGLISH CREEK MANOR M H PARK	0.07	0.07	0.07	0.07	0.08	3.84	3.88	3.93	3.96
NJ0108003	TILTON TERRACE MH	0.00	0.00	0.00	0.00	0.00	-0.10	-0.05	0.00	0.04
NJ0108004	NORMS DALE MOBILE HOME PARK	0.06	0.06	0.06	0.06	0.06	2.80	2.84	2.89	2.92
NJ0108005	AQUA NJ - SEAVIEW HARBOR	0.06	0.03	0.04	0.04	0.04	1.55	1.63	1.75	1.83
NJ0108006	TOWER MOBILE HOMES	0.08	0.08	0.08	0.08	0.08	6.56	6.60	6.65	6.69
NJ0108009	STONEY FIELD MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108013	TOWER 1999 MOBILE HOME PARK	0.07	0.07	0.07	0.07	0.07	2.65	2.68	2.73	2.77
NJ0108014	TOWER EAST MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108019	OAK FOREST MOBILE HOME PARK	0.04	0.04	0.04	0.04	0.05	1.34	1.38	1.43	1.46
NJ0108023	EGG HARBOR RIVER RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108303	BAY BREEZE VILLAGE	0.10	0.10	0.10	0.10	0.10	112.72	112.79	112.89	112.96
NJ0111004	POMONA MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111006	SHADY PINES CAMPING RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111007	SWAN LAKE RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0112001	HAMILTON TOWNSHIP MUA	1.16	1.21	1.29	1.40	1.48	0.60	0.64	0.70	0.74
NJ0112002	BLACK HORSE MANOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0113001	HAMMONTON WATER DEPT	0.47	0.35	0.41	0.49	0.55	0.27	0.32	0.38	0.42
NJ0115001	LONGPORT WATER DEPARTMENT	-0.02	-0.03	-0.02	0.01	0.03	-0.08	-0.04	0.02	0.06

PWSID	PWSID NAME	2021 Deficit/ Surplus	Future Water Availability for 2050 (mgd)				Normalized Water Availability for 2050 (-)			
			NCNWL	NCOWL	CNWL	COWL	NCNWL	NCOWL	CNWL	COWL
NJ0102001	ATLANTIC CITY MUA	12.56	12.61	13.06	13.67	14.08	1.18	1.22	1.28	1.32
NJ0103001	BRIGANTINE WATER DEPARTMENT	0.55	0.17	0.26	0.39	0.47	0.10	0.15	0.22	0.26
NJ0104003	BUENA BOROUGH MUA	0.12	0.08	0.11	0.14	0.16	0.16	0.20	0.26	0.30
NJ0105001	BUENA FAMILY MANOR MOBILE H P	0.09	0.09	0.09	0.09	0.09	13.95	14.00	14.06	14.10
NJ0105002	GARDEN HOMES MANAGEMENT CORPORATION	0.07	0.07	0.07	0.07	0.07	3.99	4.04	4.09	4.13
NJ0107001	EGG HARBOR CITY WATER DEPT	0.19	0.18	0.20	0.22	0.23	0.56	0.60	0.66	0.70
NJ0108002	ENGLISH CREEK MANOR M H PARK	0.07	0.07	0.07	0.07	0.08	3.84	3.88	3.93	3.96
NJ0108003	TILTON TERRACE MH	0.00	0.00	0.00	0.00	0.00	-0.10	-0.05	0.00	0.04
NJ0108004	NORMS DALE MOBILE HOME PARK	0.06	0.06	0.06	0.06	0.06	2.80	2.84	2.89	2.92
NJ0108005	AQUA NJ - SEAVIEW HARBOR	0.06	0.03	0.04	0.04	0.04	1.55	1.63	1.75	1.83
NJ0108006	TOWER MOBILE HOMES	0.08	0.08	0.08	0.08	0.08	6.56	6.60	6.65	6.69
NJ0108009	STONE FIELD MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108013	TOWER 1999 MOBILE HOME PARK	0.07	0.07	0.07	0.07	0.07	2.65	2.68	2.73	2.77
NJ0108014	TOWER EAST MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108019	OAK FOREST MOBILE HOME PARK	0.04	0.04	0.04	0.04	0.05	1.34	1.38	1.43	1.46
NJ0108023	EGG HARBOR RIVER RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0108303	BAY BREEZE VILLAGE	0.10	0.10	0.10	0.10	0.10	112.72	112.79	112.89	112.96
NJ0111004	POMONA MOBILE HOME PARK	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111006	SHADY PINES CAMPING RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0111007	SWAN LAKE RESORT	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0112001	HAMILTON TOWNSHIP MUA	1.16	1.21	1.29	1.40	1.48	0.60	0.64	0.70	0.74
NJ0112002	BLACK HORSE MANOR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NJ0113001	HAMMONTON WATER DEPT	0.47	0.35	0.41	0.49	0.55	0.27	0.32	0.38	0.42
NJ0115001	LONGPORT WATER DEPARTMENT	-0.02	-0.03	-0.02	0.01	0.03	-0.08	-0.04	0.02	0.06