
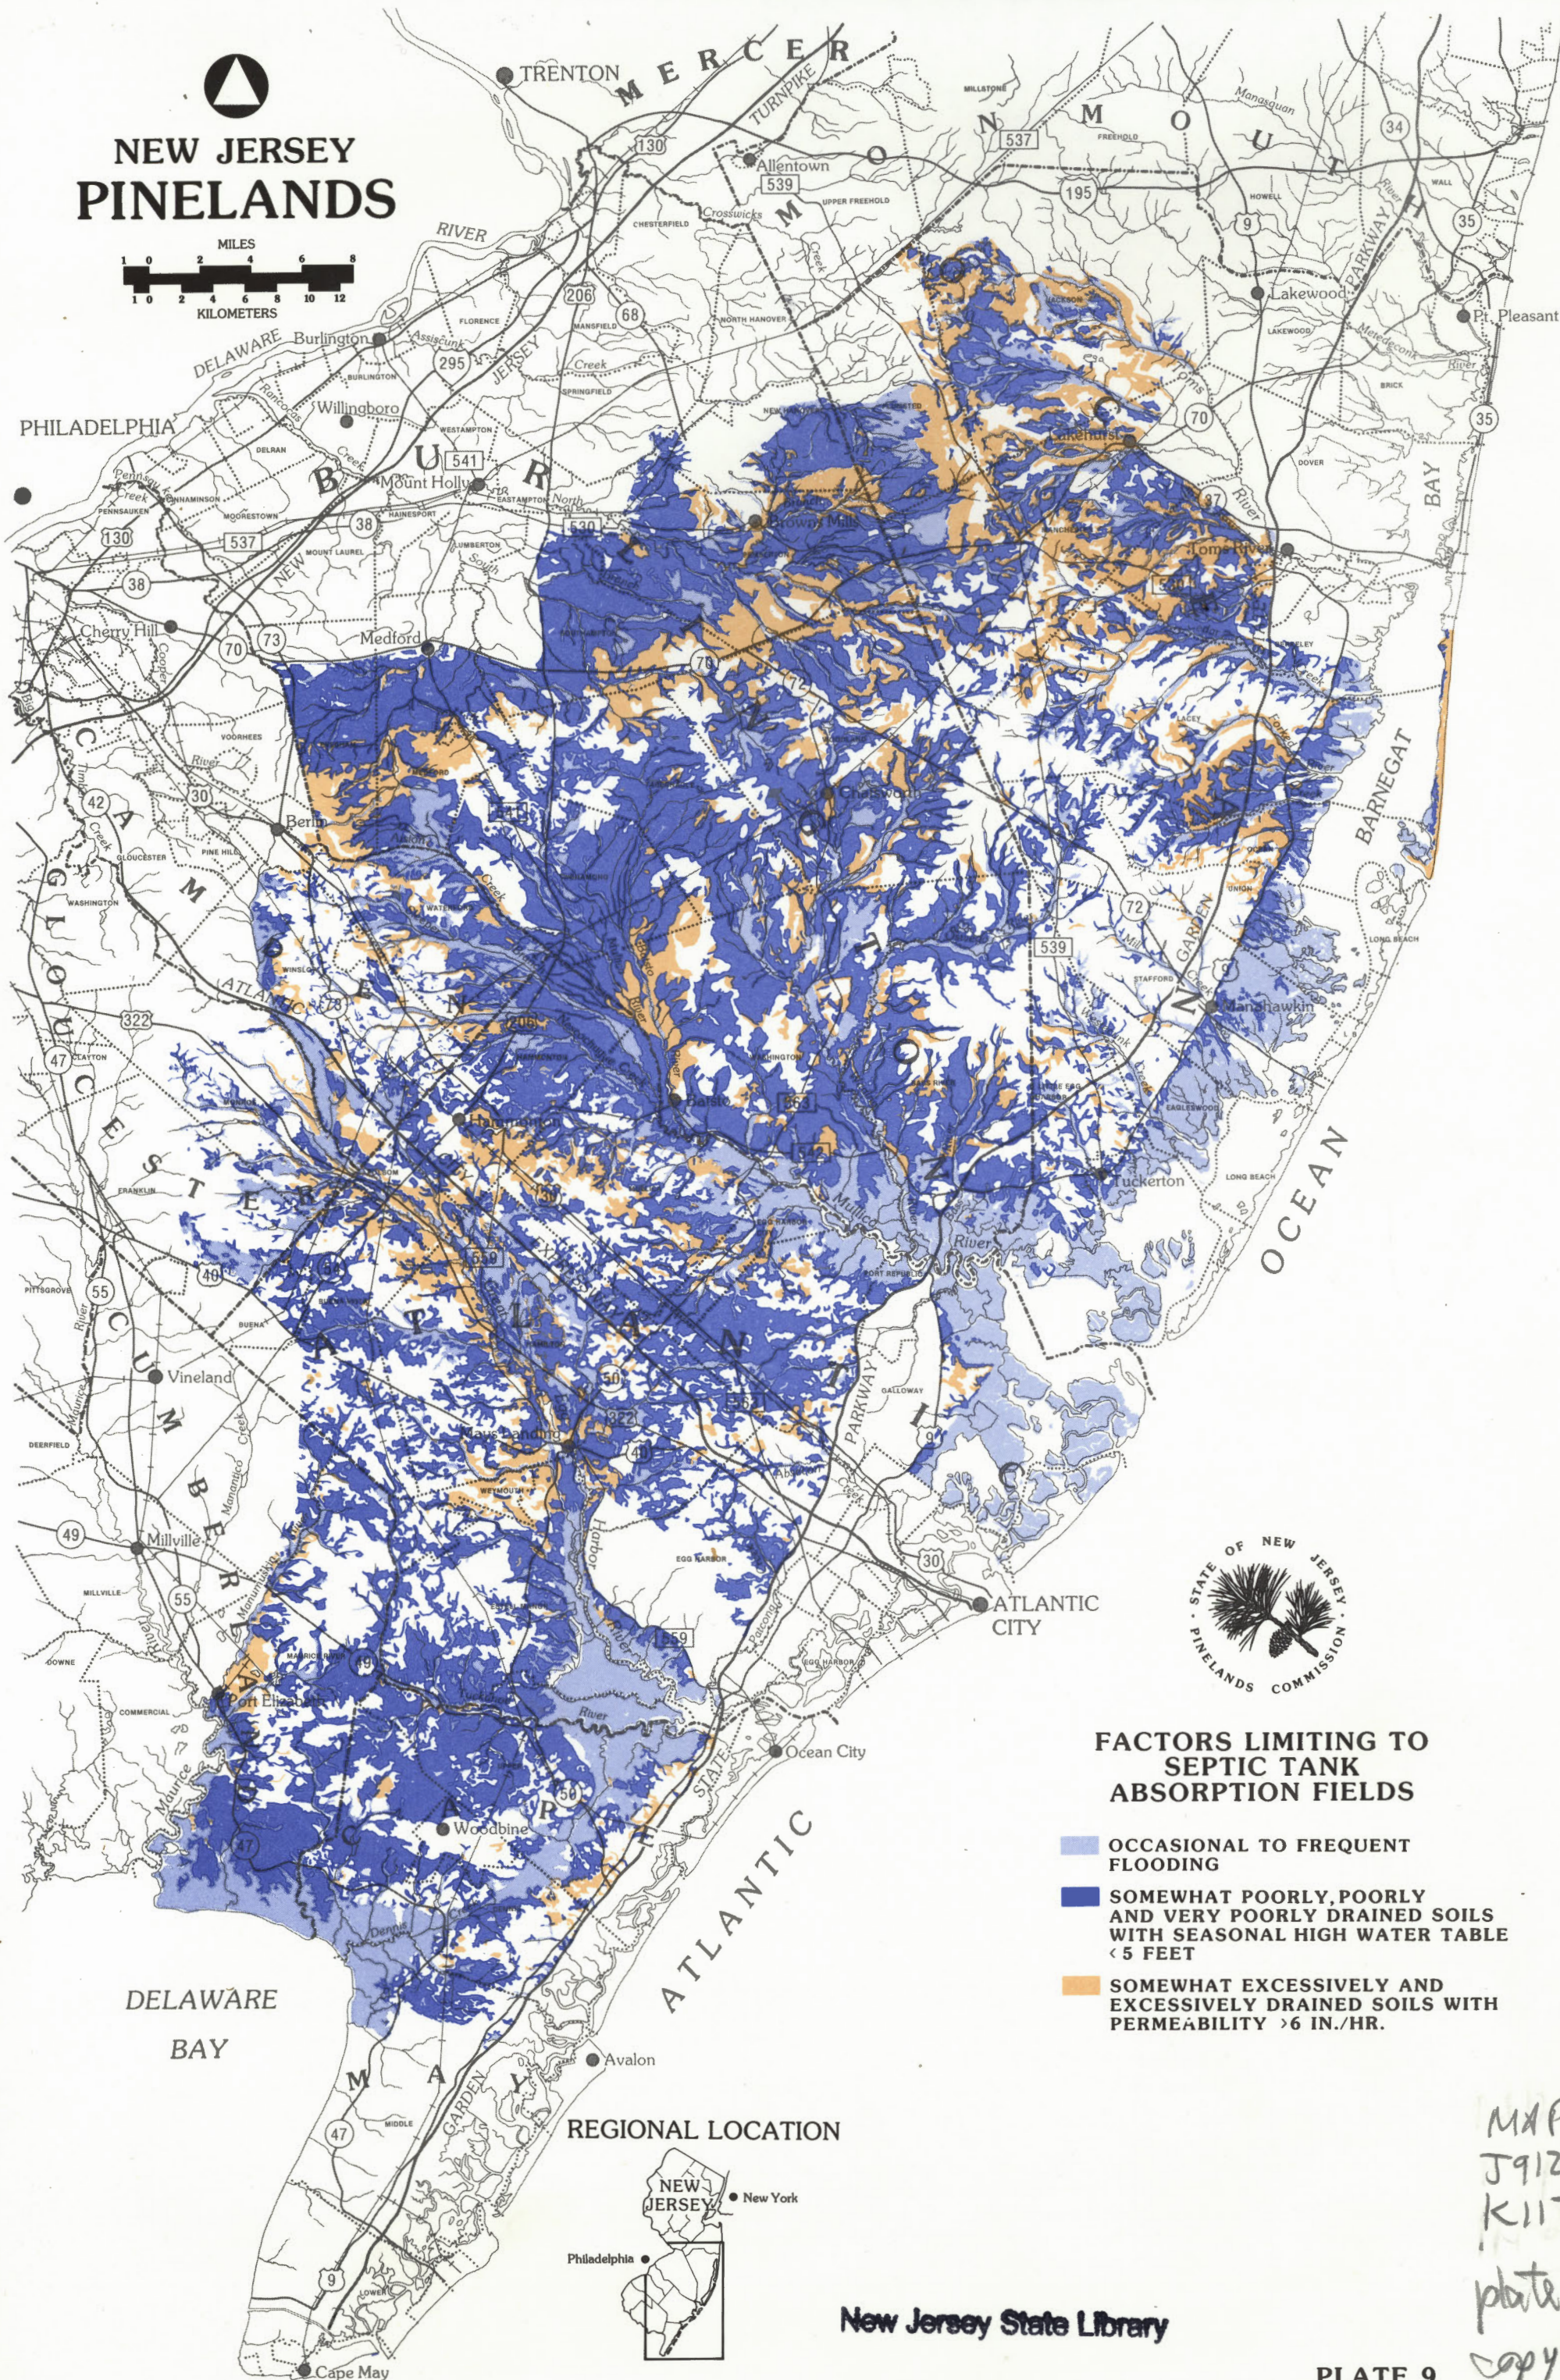


NEW JERSEY PINELANDS



FACTORS LIMITING TO SEPTIC TANK ABSORPTION FIELDS

- OCCASIONAL TO FREQUENT FLOODING
- SOMEWHAT POORLY, POORLY AND VERY POORLY DRAINED SOILS WITH SEASONAL HIGH WATER TABLE < 5 FEET
- SOMEWHAT EXCESSIVELY AND EXCESSIVELY DRAINED SOILS WITH PERMEABILITY > 6 IN./HR.

REGIONAL LOCATION



New Jersey State Library

MAP
J912.9
K117
plate 9
copy 1